



WOOD POLE STRUCTURE
THREE POLE STRUCTURE SIMILAR

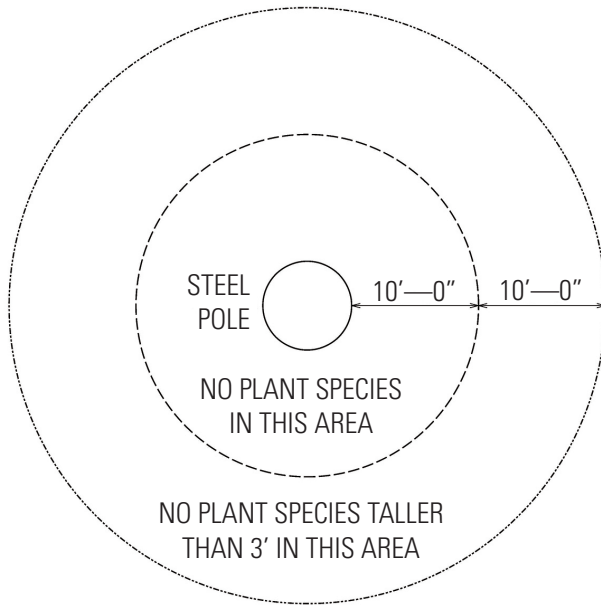

STEEL POLE STRUCTURE

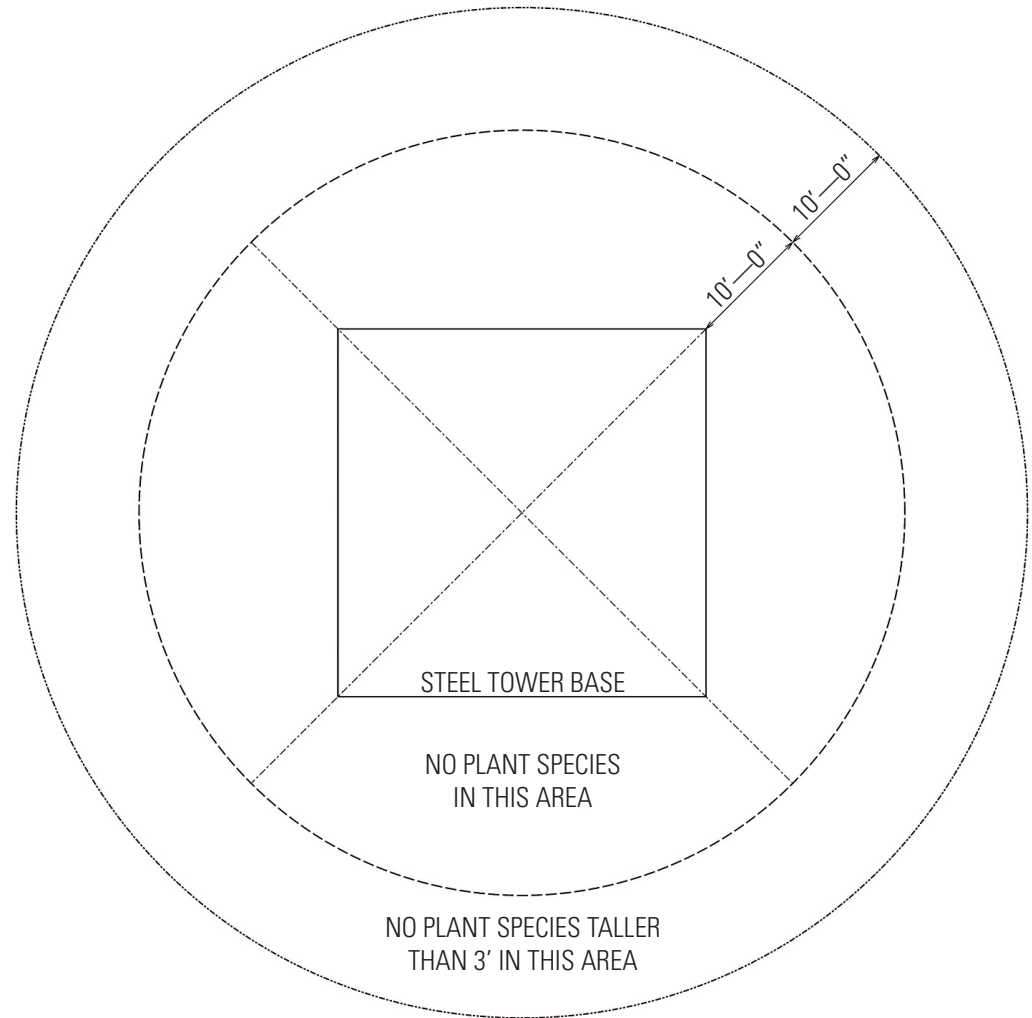

STEEL TOWER

Clearing Around Structures

To ensure safety and reliability, plant species within 10' of any transmission structure/tower base or guy wire will be removed.

From 10' to 20' around structure/tower base or guy wire, plant species that normally reach a mature height greater than 3' will be removed.

Exceptions will be made for annual crops such as corn, soybean, rye, winter wheat, and wildlife food plots.