

SERVICES

09



SERVICES
TABLE OF CONTENTS

STANDARD CONDUCTOR DATA.....09 00 01 01

EXPANSION SHIELDS.....09 00 01 02

POINT OF ATTACHMENT TO BUILDINGS.....09 00 02 03

ATTACHMENT CLEARANCE.....09 00 02 05

SERVICE INSTALLATION CLEARANCES.....09 00 03 01

UNGUYED SAG TABLES.....09 00 04 01

MULTIPLE SERVICE CABLE INSTALLATION TO HOUSE OR SERVICE MAST.....09 01 10 **

ATTACHMENTS AT POLES AND BUILDINGS - 500KCMIL TO 1000KCMIL.....09 01 12 00

SERVICE TAKEOFF AT POLE - TRIPLEX SECONDARY.....09 01 28 00

SERVICE TAKEOFF AT POLE - PARALLEL LASHED SECONDARY.....09 01 30 00

SERVICE TAKEOFF AT POLE - OPEN WIRE SECONDARY.....09 01 32 00

FLYING SERVICE - #2 TRIPLEX AND SMALLER - PARALLEL LASHED OR
TRIPLEX SECONDARY.....09 01 34 00

FLYING SERVICE - #2 TRIPLEX AND SMALLER - OPEN WIRE SECONDARY.....09 01 36 **

FLYING SERVICE - 1/0 OR LARGER TRIPLEX.....09 01 38 **

SERVICE ATTACHMENT ON BUILDING - SECONDARY CLEVIS.....09 01 49 **

SERVICE CABLE ATTACHMENT ON BUILDING.....09 01 50 **

SERVICE ATTACHMENT ON BUILDING AND MAST - WIRE HOLDER.....09 01 51 **

SERVICE ATTACHMENT ON BUILDING - 1 & 2 - WIRE SECONDARY RACK.....09 01 53 **

SERVICE ATTACHMENT ON BUILDING - 3 & 4 - WIRE SECONDARY RACK.....09 01 54 **

BUS DUCT - OVER 800 AMP.....09 01 56 00

WEATHERHEAD ATTACHMENT - OVER 800 AMP.....09 01 58 00

TRIPLEX SERVICE CABLE SPLICES.....09 01 60 **



SERVICES

Standard Conductor Data

This standard covers standard conductor sizes, respective stock codes, and ampacities.

Table 1 - Triplex Cable						
Insul. Cond.	Messenger	Stock #	Dia. (in.)	Wt. (#/ft)	Summer	Winter
#2 AA - 7 Str.	#2 AA - 7 Str.	18 05 040	0.77	.241	150	195
1/0 AA - Str.	1/0 AA - 19 Str.	18 05 044	1.00	.381	205	265
4/0 AA - 19 Str.	4/0 AA - 19 Str.	18 05 064	1.31	.719	315	410

Table 2 - Quadruplex Cable						
Insul. Cond.	Messenger	Stock #	Dia. (in.)	Wt. (#/ft)	Summer	Winter
1/0 A.A. - 19 Str.	1/0 A.A. - 7 Str.	18 05 104	1.09	0.644	180	235
4/0 A.A. - 19 Str.	4/0 A.A. - 19 Str.	18 05 105	1.47	1.099	275	360

CONSTRUCTION NOTE(S):

1. Triplex cable shall be used for all new 3 wire service drop installations where its current rating is adequate and the voltage is less than 300 volts. Quadruplex cable should only be used on 4-wire services. Where the ratings of triplex and quadruplex cables are exceeded, open wire services shall be installed using covered conductors tabulated in DCS **Section 7**. These conductors may also be used for repair and maintenance of existing open wire services.
2. #2 Triplex shall be used for most 200 Amp services. #1/0 and larger triplex and quadruplex are primarily for commercial or industrial customer where larger capacity is needed.
3. Triplex cable should not be used on 480 volt service. It is rated 600 volts phase to phase, not phase to ground. Quadruplex cable can be used for 277/480 volt service, but not for 480 volt, 3 wire service since the bare messenger must be grounded by NESC.
4. All connections of services to customer's service wires shall be adequately arranged to prevent moisture entrance at the weatherhead. Preferable construction is for the weatherhead to be above the service wire connections with a drip loop in the latter. For services larger than residential and small commercial, see DCS **09 01 12 00**.
5. Tree guards should be used on original installations of triplex service cables where the cables go through trees or where trees have become a problem since the original installation. These 2 piece plastic tree guards are stocked for #4 (Stock #25 54 047), #2 (Stock #25 54 048) and #1/0 (Stock #25 54 049) triplex cable. The tree guard for #4 triplex (Stock #25 54 047) may be used for #6 duplex cable if the ends of the guard are securely taped to the cable.

REV	DATE	ENG	DESCRIPTION
12	01/01/21	WYW	Moved Expansion Shields data to new standard 09 00 01 02
11	02/06/08	DCG	



SERVICES

Expansion Shields

09 00 01 02

1 of 2

Table 1 - Standard Expansion Shields Stock Codes and Working Loads

Expansion Shield		Safe Working Load (Tension) In Lbs
Size	Stock #	
1/4"	21 51 009	175 (with lag screw)
1/4"	21 51 010	300 (with machine bolt)
5/16"	21 51 181	350 (with lag screw)
3/8"	21 51 055	350 (with lag screw)
3/8"	21 51 016	865 (with machine bolt)
1/2"	21 51 017	920 (with lag screw)
1/2"	21 51 018	1370 (with machine bolt)
5/8"	21 51 019	2430 (with machine bolt)

Table 2 - Expansion Shields Used for House Knob

Expansion Shield		Drill Size	Exp. Shield Used With Wood Screw Type Wireholder		Application
Size	Stock #		Screw Size	Wireholder Stock #	
3/8"	21 51 055	5/8"	#22 x 2-1/4" Woodscrew	23 06 077	Used to attach wireholder insulators to masonry walls.

2 Table 3 - Expansion Shields for Wood or Lag Screws

Expansion Shield		Drill Size	Exp. Shield Used With			
Size	Stock #		Brass Screw		Lag	
			Size	Stock #	Size	Stock #
1/4"	21 51 009	1/2"	#14 x 2"	21 71 022	1/4" x 2"	21 65 017
					1/4" x 2-1/2"	21 65 018
					1/4" x 4"	23 60 002

Table 4 - Expansion Shields for Machine Bolts

Expansion Shield		Drill Size	Expansion Shield Used With		Application
Size	Stock #		Bolt Size	Bolt Stock #	
3/8"	21 51 016	5/8"	3/8" x 3"	23 52 194	Fastening clevises deadending up to #4 AWG services inclusive. Up to 750 kcmil on brackets along masonry walls.
1/2"	21 51 018	7/8"	1/2" x 4"	23 52 034	Fastening clevises deadending up to #2 to 4/0 AWG services inclusive
5/8"	21 51 019	1"	5/8" x 4"	23 52 200	Fastening clevises, deadending 500 kcmil and 750 kcmil services and network cable brackets on masonry walls.

REV	DATE	ENG	DESCRIPTION
1	01/01/21	WYW	Data moved from DCS 09 00 01 01
	xx/xx/xx	xxx	




CONSTRUCTION NOTE(s):


1. Safe working loads given are for a good installation in a good grade of masonry. For expansion shields used with machine bolts (normally used for the heavier loads) this means placing the shield in brick or concrete or if a brick seam is used, it shall be narrow and preferably filled with a cement mortar.

2. The expansion shield shown in Table 3 is for use with wood screws and lag screws. This assembly is normally used to attach service entrance cable, corner brackets and service entrance boxes to masonry walls. The length of the lag screw used will depend on the condition of the masonry and how deep the shield is set in the wall. The #14 x 2" screw shown is also used to fasten meter, meter enclosures, service entrance cable, etc. to wood frame building. In masonry this screw with shield is convenient to use and provides good holding power in sound masonry walls for light loads.

REV	DATE	ENG	DESCRIPTION
1	01/01/21	WYW	Data moved from DCS 09 00 01 01
	xx/xx/xx	xxx	

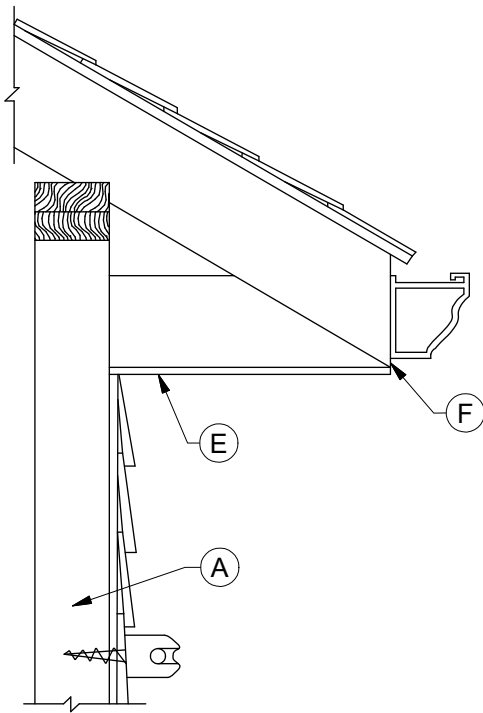


Frame-Composition Shingle or
Brick Veneer Construction

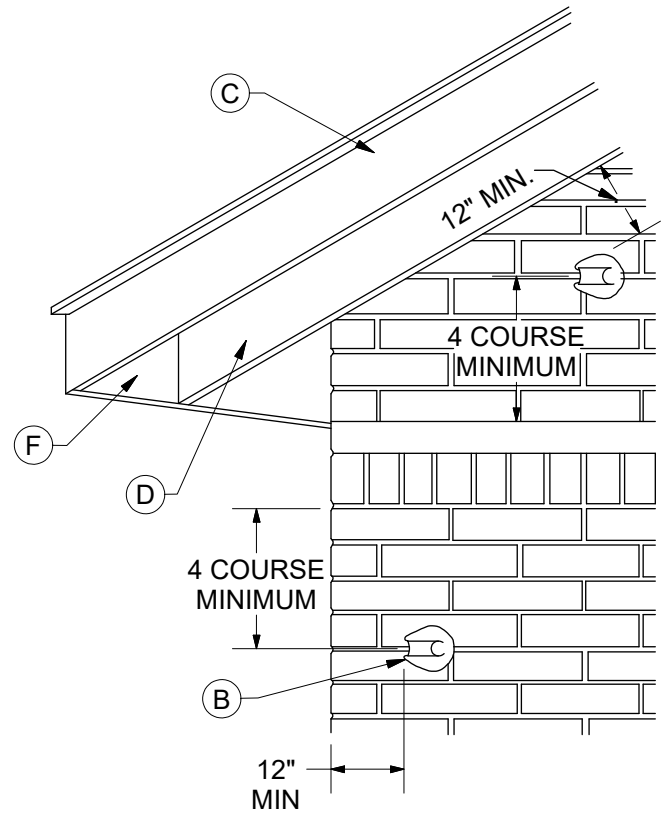

Brick or Solid Masonry Construction

ITEM	DESCRIPTION	Acceptable/Un-acceptable Point of Attachment
A	Building Studs	Acceptable
B	Mortar Joints	Acceptable
C	Outside Trim Board	Attachment allowed only if adequately reinforced
D	Inside Trim Board (Brick Building)	Attachment allowed only if adequately reinforced
E	Soffit Board	Attachment allowed only if adequately reinforced
F	Fascia Board	Un-Acceptable
G	Fire Walls, Parapet Walls or Chimneys	Un-Acceptable

REV	DATE	ENG	DESCRIPTION
1	01/01/21	WYW	Updated drawing and created description table
0	09/26/11	DCG	

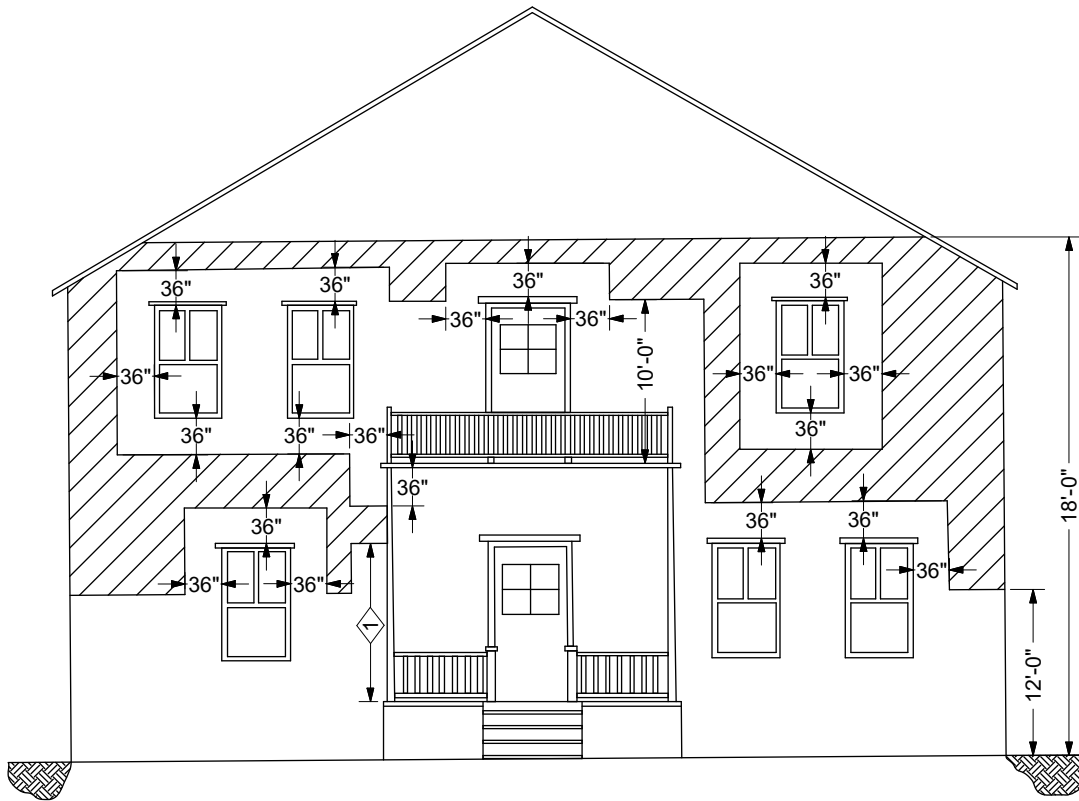

CONSTRUCTION NOTE(S):

1. The first point of attachment for new electric service shall be in shaded spaces not less than 12' nor more than 18' above ground. It maybe necessary to attach services higher in order to meet minimum ground clearances on DCS 09 00 03 01. Existing services may be reconducted to the original clearance or a minimum of 10' above ground. A service mast may be used if necessary to obtain the minimum clearances.
2. The customer's service outlet not be located above 18', but it may be necessary to attach services higher than 18' to meet the minimum ground clearances on DCS **09 00 03 01**.
3. Triplex cable or separate open wire service busses on buildings shall be placed in the spaces shown shaded.
4. Service conductors passing by doors, porches, fire escapes or similar locations, shall have a clearance of not less than 36 inches. Service conductors passing by windows shall have a clearance of not less than 36 inches.
5. Where the form of the building will not permit triplex cable or open wire service busses from the point of attachment to the service outlets, service entrance cable may be used for runs up to 15'. For runs in excess of 15', the information must be submitted to Ameren project contact and must be approved by the appropriate Supervising Engineer before the project. Service entrance cable is only rated for 300 volts.
6. When service entrance cable is used, clearances between windows, openings, fire escapes, etc, and the service attachment or the service busses on the building may be reduced to 6 inches. This is a preferred minimum which may however be reduced if necessary.
7. Service conductors shall not be installed beneath openings through which materials may be moved, such as openings in farm and commercial buildings. Overhead wires shall not be run such that they obstruct entrance to these building openings.

REV	DATE	ENG	DESCRIPTION
2	01/01/21	WYW	Revised note 1 and combined w/DCS 09 00 02 06
1	10/06/11	DCG	



SERVICES

Attachment Clearances


09 00 02 05
600V
2 of 2

8. In some instances the first set of wire attachments cannot be located in an acceptable space which will permit either direct connection or extension of a triplex cable or open wire bus to the service outlet. Examples of this are inadequate ground clearances in the service span, building materials that preclude fastenings being placed on them, load center being so placed that the service entrance location is confined to a specific part of the building, etc.

In these cases, the use of Service Entrance Cable is permitted from the first point of attachment to the service entrance. Service Entrance Cable is only rated for 300 volt services

9. On existing services when the customer has not changed the original service entrance facilities, the service wires maybe replaced at the original clearances. If the customer has installed a new service entrance, then the new facilities and service wires must comply with the current requirements.

REV	DATE	ENG	DESCRIPTION
2	01/01/21	WYW	Revised note 1 and combined w/DCS 09 00 02 06
1	10/06/11	DCG	

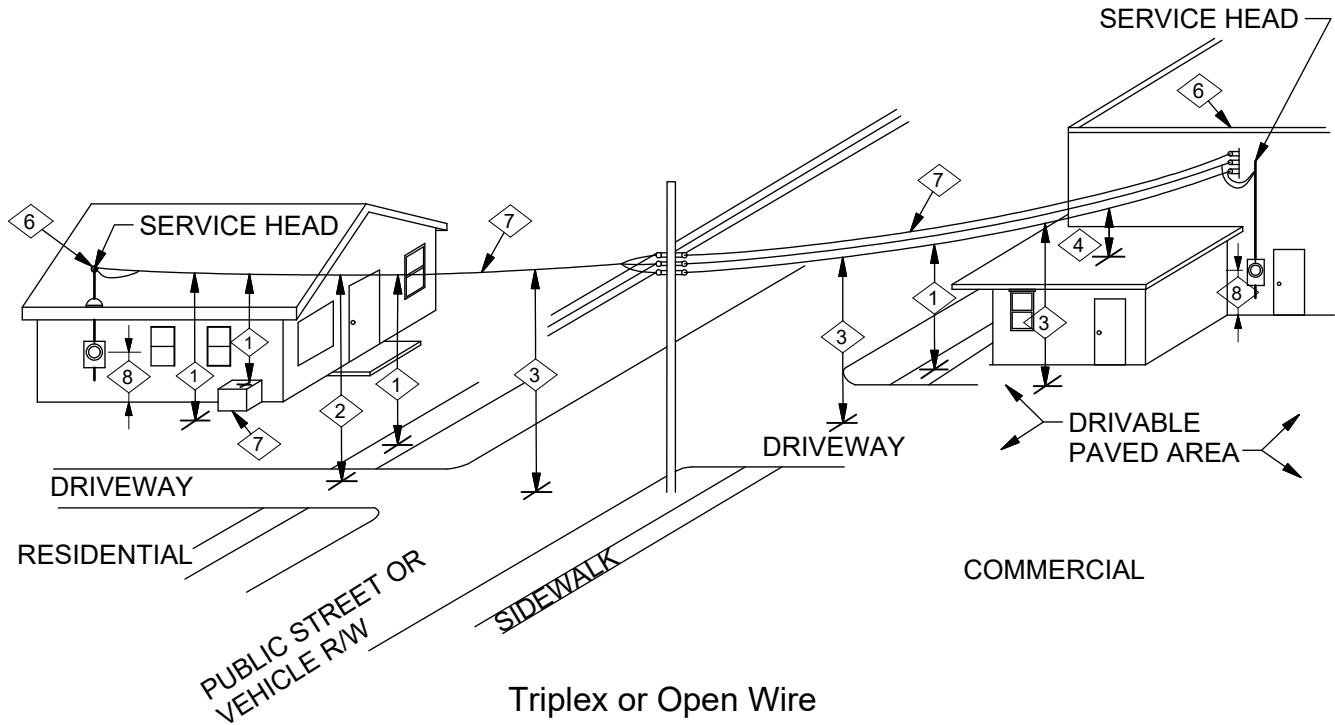

DESIGN NOTE(s):

Over Ground (per 2017 NESC 232)

1. 12 ft. (triplex) or 12.5 ft. (open wire) over spaces and ways subject to pedestrian or restricted traffic only (no vehicles over 8 ft. high).

EXCEPTION: Where height of a residential building does not allow these clearances, clearance may be reduced to 10 ft. at the drip loop or service drop for triplex cable limited to 150 volts to ground or 10.5 ft. for open wire limited to 300 volts to ground.

2. 16 ft. (triplex) or 16.5 ft. (open wire) over driveways, parking lots and alleys.

EXCEPTION: Where height of a residential building does not allow these clearances, clearance may be reduced to 12 ft. for triplex service limited to 150 volts to ground or 12.5 ft. for open wire limited to 300 volts to ground.

3. 16 ft. (triplex) or 16.5 ft. (open wire) over roads, streets, alleys, non-residential driveways, parking lots and other areas subject to truck traffic.

EXCEPTION: Services over state and federal commercial highways shall be no less than 18 ft. Services over Illinois limited access highways shall be no less than 20 ft.

Over Roofs (includes Parking Garages) (per 2017 NESC 234C)

4. Clearances from highest point in roof shall not be less than:
- A. 3.5 ft. (triplex) or 10.5 ft. (open wire) over roofs not accessible to pedestrians (see note 9).
 - B. 11 ft. (triplex) or 11.5 ft. (open wire) over roofs accessible to pedestrians.
 - C. 11 ft. (triplex) or 11.5 ft. (open wire) over roofs accessible to vehicles but not truck traffic.
 - D. 16 ft. (triplex) or 16.5 ft. (open wire) over roofs accessible to truck traffic.

REV	DATE	ENG	DESCRIPTION
7	01/01/21	WYW	Removed Fig 1, renumbered drawing and re-formatted notes
6	04/01/19	WYW	



SERVICES

Service Installation Clearances

09 00 03 01
600V
2 of 2

EXCEPTIONS:

A. For services attached to a building (including drip loops) and where voltage between conductors does not exceed 300 volts on a non-accessible roof, a reduction in clearance over the roof is permitted as follows:

I. 3 feet

II. 18 inches within 6 feet of and terminated at a through the roof raceway or approved support located not more than 4 feet from the edge of roof.

- 5. Any equipment housing including air conditioning, platform or projection which a person might stand on.
- 6. Service mast or bracket attachment or upright of adequate size and height to support services required.
- 7. Normally triplex conductors, but may also be separate conductors as shown for commercial services.
- 8. Meter height is 3'-0" to 5'-6" except 6'-6" over walkways less than 3" wide.
- 9. A roof is considered accessible to pedestrians if there is a means of access through a doorway, ramp, stairway, or permanently mounted ladder.

REV	DATE	ENG	DESCRIPTION
7	01/01/21	WYW	Removed Fig 1, renumbered drawing and re-formatted notes
6	04/01/19	WYW	



SERVICES

Unguyed Sag Tables


The table below provides wire sag conditions that will result in 600 lbs. or less tension under NESC heavy loaded conditions. Sag values may be increased to reduce tension provided the minimum L-G clearance specified in DCS 09 00 03 01 is maintained. Sag values are based on an attachment height of 12 feet at the user's facility and 22 feet at the pole (or secondary if service is a flying loop) except where noted. In case of uneven terrain adjustments in the attachments heights may be necessary.

Unguyed Sag						
Conductor	Temperature Deg. F Initial	Span (ft.) / Sag (in.)				
		25	50	75	100	125
#6 Duplex (w/ #6 ACSR neutral)	0 - 32	32	65	65	63	60
	33 - 50	32	65	66	64	62
	51 - 68	32	65	66	66	64
	69 - 85	32	65	66	66	65
	86 -100	32	65	67	66	65
#2 Triplex (w/ 1/0 AAC neutral)	0 - 32	27	62	65	57	45
	33 - 50	27	62	66	59	48
	51 - 68	27	62	66	60	49
	69 - 85	27	63	67	61	51
	86 -100	28	63	67	62	53
1/0 Triplex (w/ 1/0 AAC neutral)	0 - 32	36	56	66	61	66 ⁴
	33 - 50	36	57	67	63	68 ⁴
	51 - 68	36	57	67	64	69 ⁴
	69 - 85	36	57	68	65	71 ⁴
	86 -100	37	58	68	66	72 ⁴
4/0 Triplex (w/ 4/0 AAC neutral)	0 - 32	29	69	56	62	91 ³
	33 - 50	29	70	57	64	92 ³
	51 - 68	29	70	57	65	93 ³
	69 - 85	30	70	58	66	94 ³
	86 -100	30	70	58	66	95 ³
1/0 Quadruplex (w/ 1/0 AAC neutral)	0 - 32	8	55	49	47	75 ⁵
	33 - 50	9	55	50	49	77 ⁵
	51 - 68	9	56	51	50	78 ⁵
	69 - 85	10	56	51	51	79 ⁵
	86 -100	10	56	52	52	80 ⁵
4/0 Quadruplex (w/ 4/0 AAC neutral)	0 - 32	28	54	49	67 ⁵	66
	33 - 50	29	54	50	68 ⁵	66
	51 - 68	29	55	51	69 ⁵	66
	69 - 85	29	55	51	70 ⁵	66
	86 -100	29	55	52	71 ⁵	66

CONSTRUCTION NOTE(s):

1. Maximum tension may be less than 600 lbs. when limited by conductor strength or minimum sags.
 2. Maximum final sag may occur at either NESC heavy loaded conditions or at maximum conductor operating temperature of 90°C (194°F) at which all of these conductors are rated.
- ³ Minimum attachment height at pole (or secondary for flying loops): 30 feet.
 - ⁴ Minimum attachment height at pole (or secondary for flying loops): 25 feet.
 - ⁵ Minimum attachment height at pole (or secondary for flying loops): 26 feet.
 - ⁶ For spans exceeding those in the table please contact Standards.

REV	DATE	ENG	DESCRIPTION
5	01/01/21	WYW	Converted to new format
4	01/17/08	DCG	

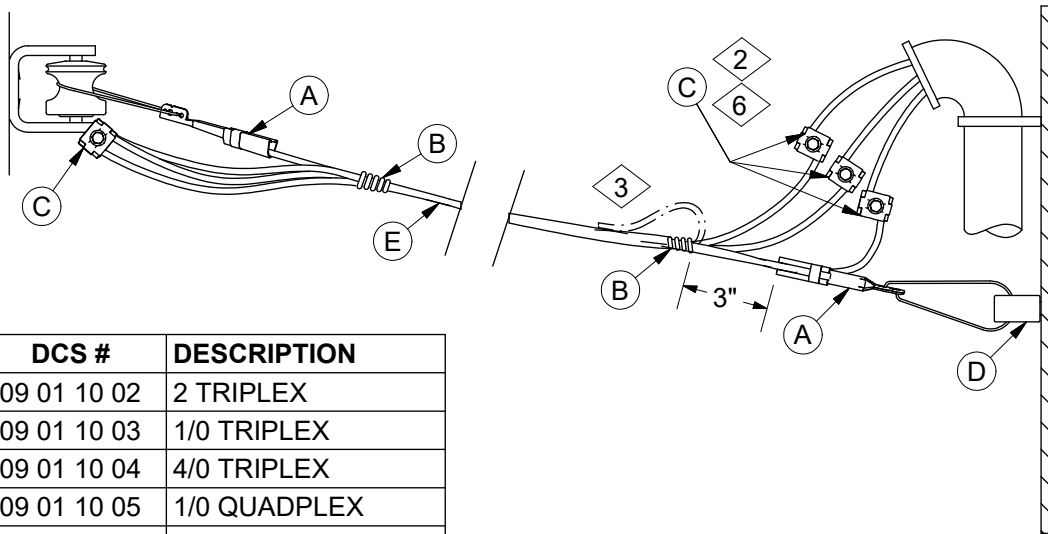


DCS #	DESCRIPTION
09 01 10 02	2 TRIPLEX
09 01 10 03	1/0 TRIPLEX
09 01 10 04	4/0 TRIPLEX
09 01 10 05	1/0 QUADPLEX
09 01 10 07	4/0 QUADPLEX

CONSTRUCTION NOTE(s):

1. For #2, 1/0 and 4/0 Triplex, spans shall not exceed 140 feet.
2. Use parallel groove clamps on 1/0 and larger services. Do not use insulated sleeves on bare messenger. Use bare sleeves or parallel groove clamps.
3. For 2 wire service, tape house end of the unused lead. Fold back triplex cable and tape securely thereto.
4. See DCS **09 00 02 04** for maximum height of service masts.
5. See DCS **09 00 04 01** for service sag table and **09 00 03 01** for service clearance chart.
6. Use compression sleeve for smaller than 1/0 conductor. The available compression sleeves are shown as below:
 - a. Stock #17 60 403 for #2 str to #2 str insulated (red/red)
 - b. Stock #17 60 406 for #2 str to #4 str insulated (red/orange)
 - c. Stock #17 60 404 for #2 solid to #4 str, non-insulated (orange/orange)

	ITEM	STK / DCS #	DESCRIPTION	09 01 10 **	02	03	04	05	07
2,6 @ @ @	A	17 51 123	Clamp, DE, #2 Triplex	2	-	-	-	-	-
		17 51 125	Clamp, DE, 1/0 Triplex & Quad.	-	2	-	2	-	-
		17 51 144	Clamp, DE, 4/0 Triplex & Quad.	-	-	2	-	2	-
	B	25 53 078	Tape, Plastic 1-1/2"	1	1	1	1	1	1
	C	07 00 25 00	Clamp, Parallel Groove	6	6	6	8	8	8
	D	09 01 51 **	Service Attachment	1	1	1	1	1	1
	E	18 05 040	Cable, Triplex, #2	#	-	-	-	-	-
		18 05 044	Cable, Triplex, 1/0	-	#	-	-	-	
		18 05 064	Cable, Triplex, 4/0	-	-	#	-	-	
		18 05 104	Cable, Quadplx., 1/0	-	-	-	#	-	
18 05 105		Cable, Quadplx., 4/0	-	-	-	-	#		

REV	DATE	ENG	DESCRIPTION
8	01/01/21	WYW	Converted to new format; Added note 6
7	12/27/11	DCG	

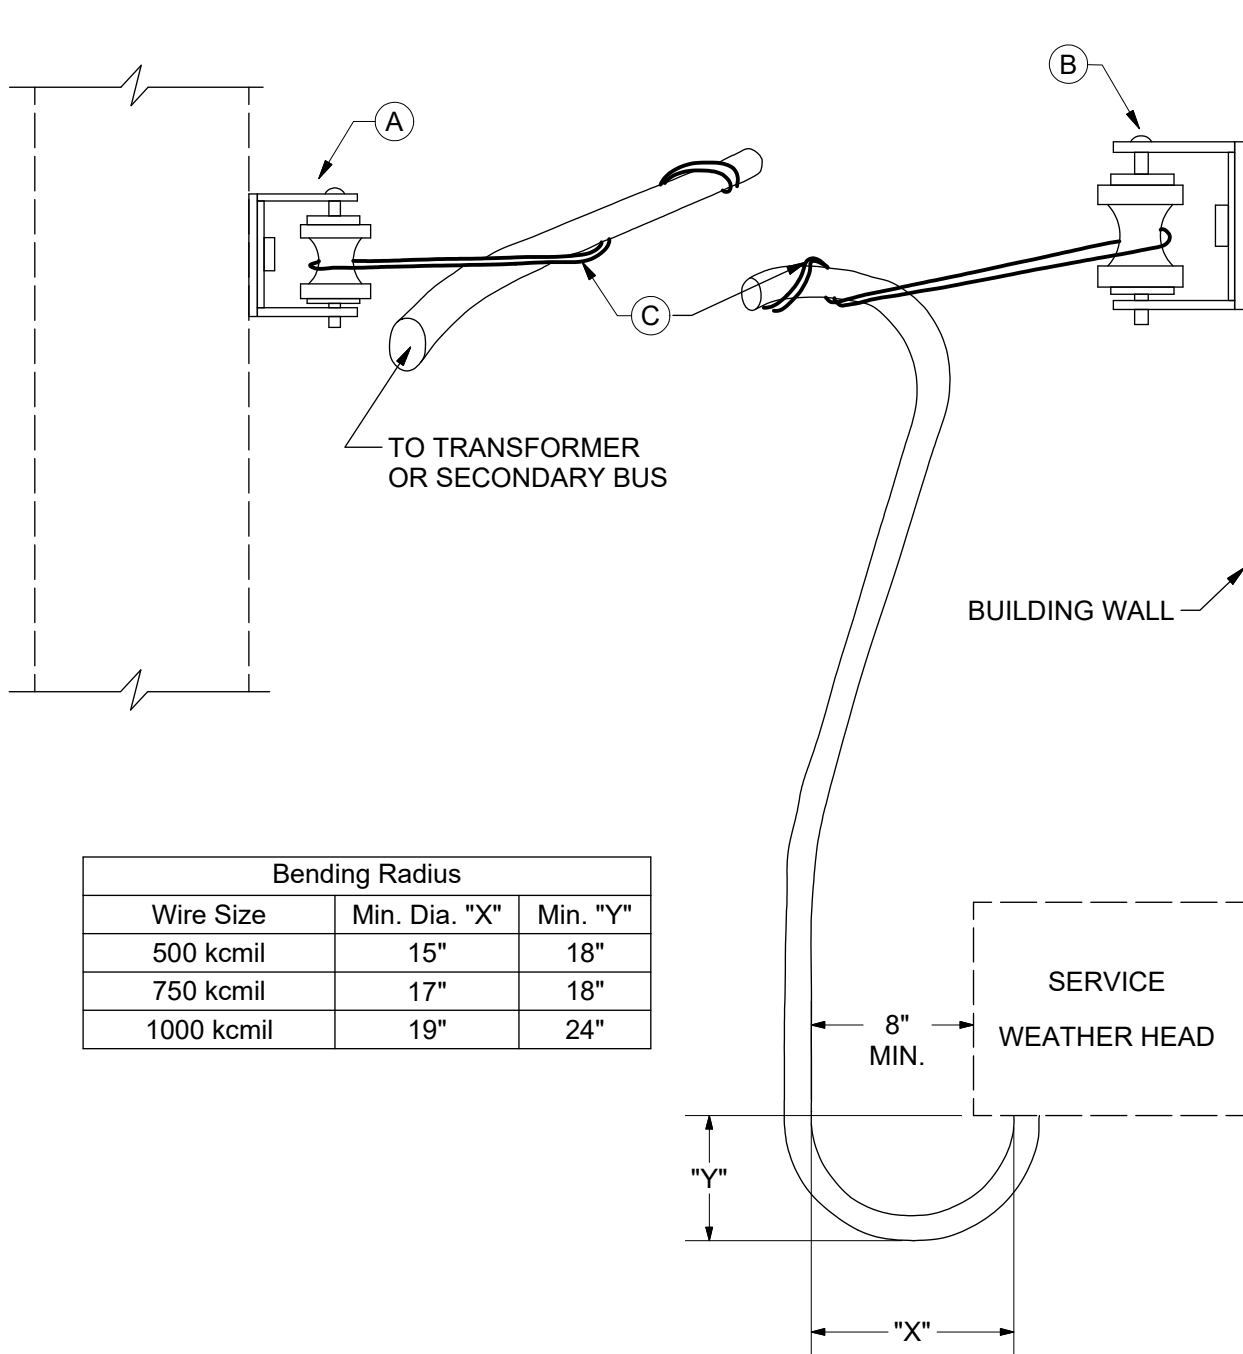


Bending Radius		
Wire Size	Min. Dia. "X"	Min. "Y"
500 kcmil	15"	18"
750 kcmil	17"	18"
1000 kcmil	19"	24"

CONSTRUCTION NOTE(s):

- Where more convenient, use DCS **08 01 10 **** for heavy services.

	ITEM	STK / DCS #	DESCRIPTION	09 01 12 **	00
@	A	06 01 01 01	Secondary Clevis		1
@	B	09 01 52 **	Service Attachment		1
		23 18 058	Grip, Preformed, Poly covered for 500 kcmil Cu		2
		23 68 703	Grip, Preformed, Poly covered for 750 kcmil Cu		2
		23 68 700	Grip, Preformed, Poly covered for 1000 kcmil Cu		2

REV	DATE	ENG	DESCRIPTION
8	01/01/21	WYW	Changed title
7	12/27/11	DCG	

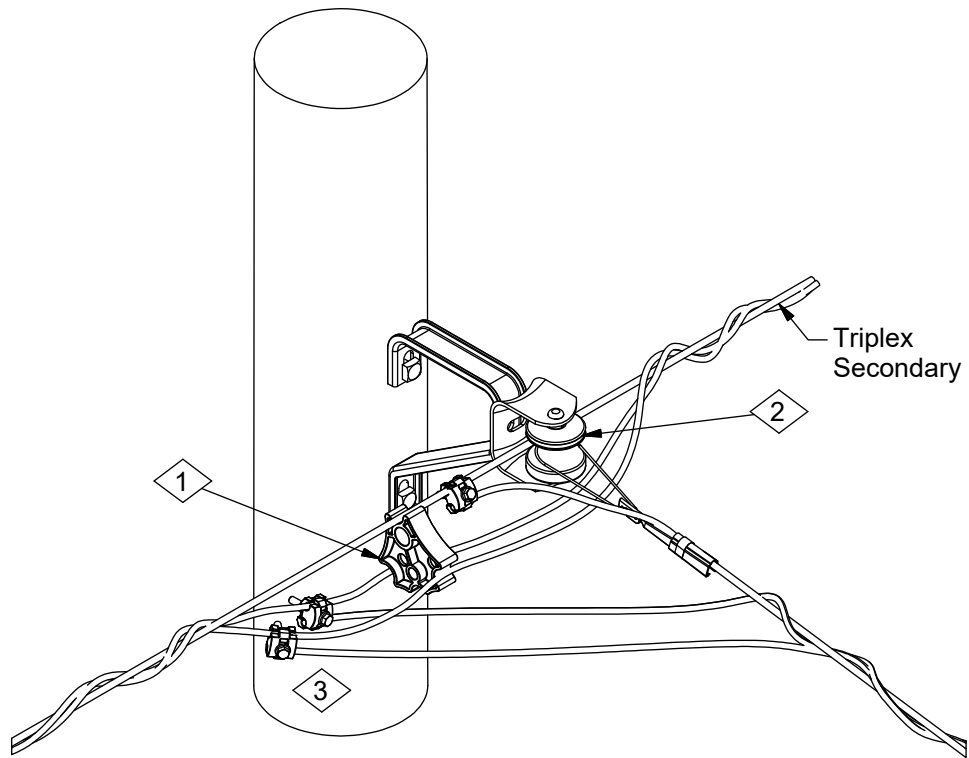


Single Service

CONSTRUCTION NOTE(s):

- ① Insert triplex spacer Stock #23 17 227 between conductors.
- ② Attach wedge clamp to the secondary insulator or triplex spacer.
- ③ Stagger the location of the connections to allow the connections to contact one another.

REV	DATE	ENG	DESCRIPTION
1	01/01/21	WYW	Converted to new format
0	10/17/06	JMW	

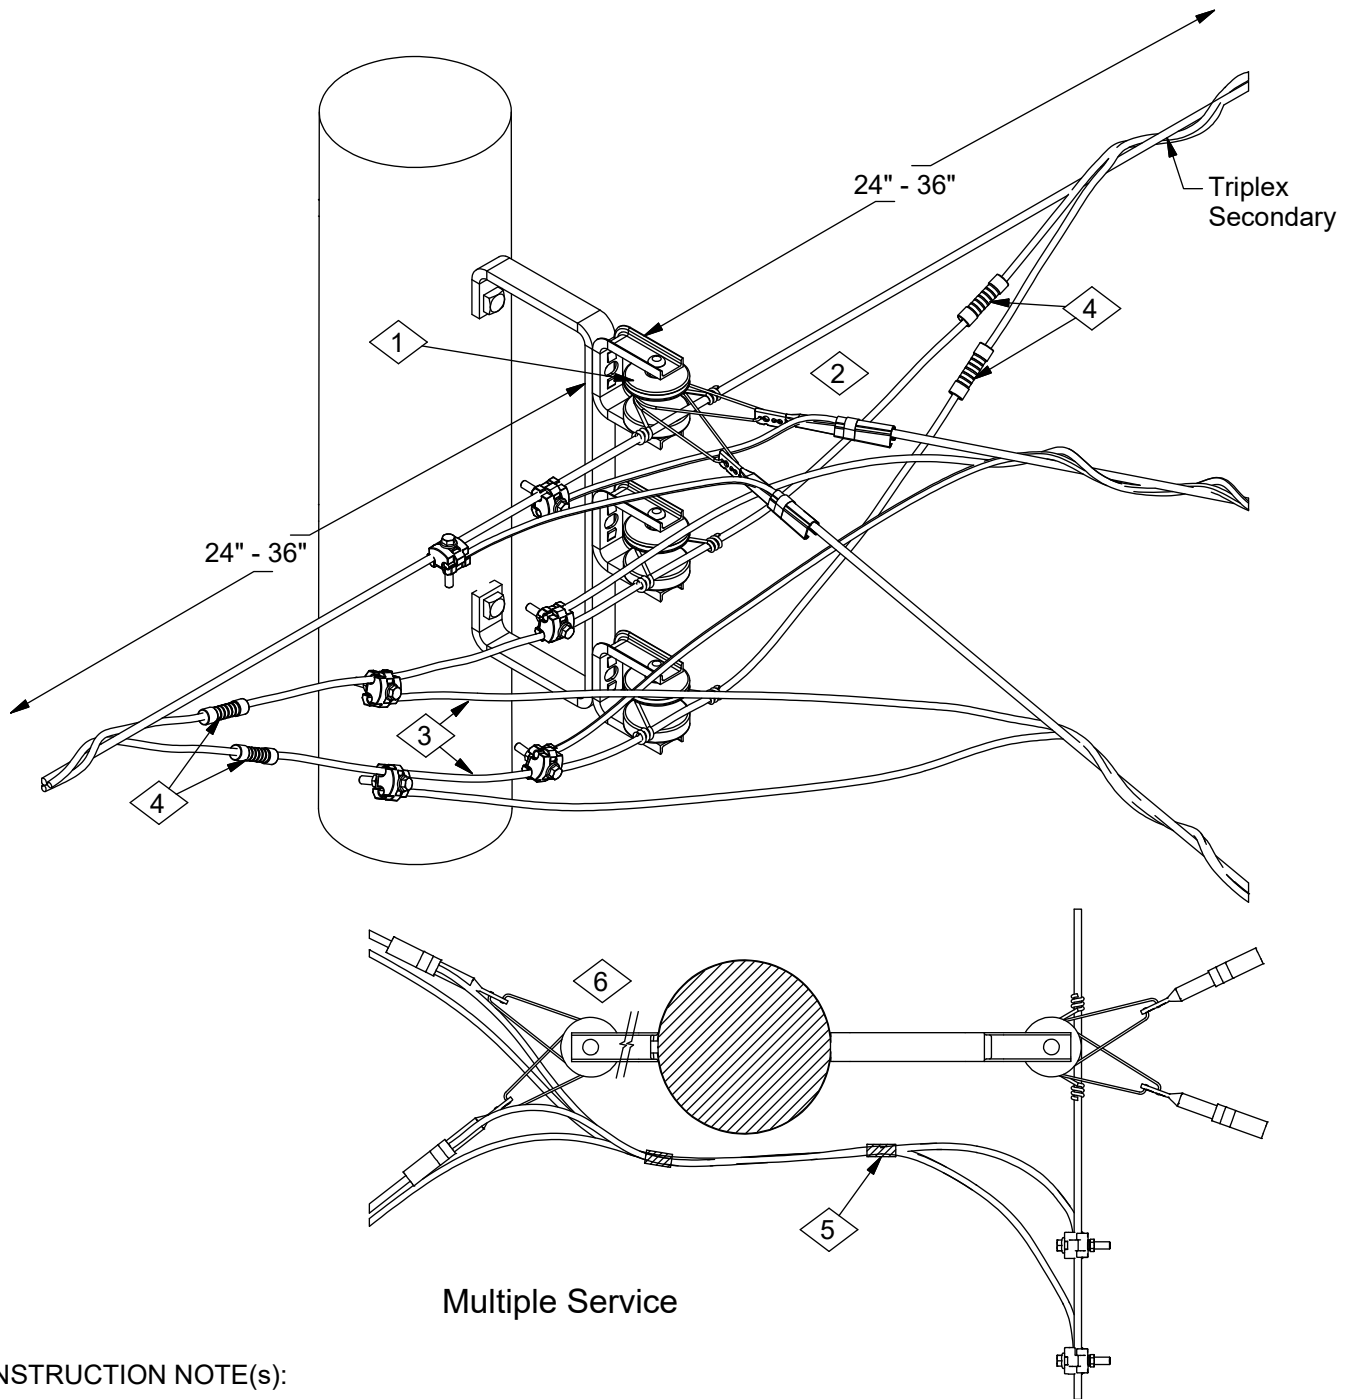


Multiple Service

CONSTRUCTION NOTE(S):

- ① Neutral position on rack should be consistent with operating company practice.
- ② Attach wedge clamp for service to the neutral conductor insulator.
- ③ Use 8 to 10 feet of new 600V wire (obtained from new triplex of same size) for extension to lower phase position or rack.
- ④ Use non-tension sleeves to splice the new insulated conductors into the triplex secondary (Stock #17 60 418) for 4/0 to 4/0Al.).
- ⑤ Bunch same phase wires to form a cable and tape as necessary.
- ⑥ When required, use extension bracket on both sides, DCS **06 01 03 ****.



REV	DATE	ENG	DESCRIPTION
1	01/01/21	WYW	Converted to new format
0	10/17/06	JMW	

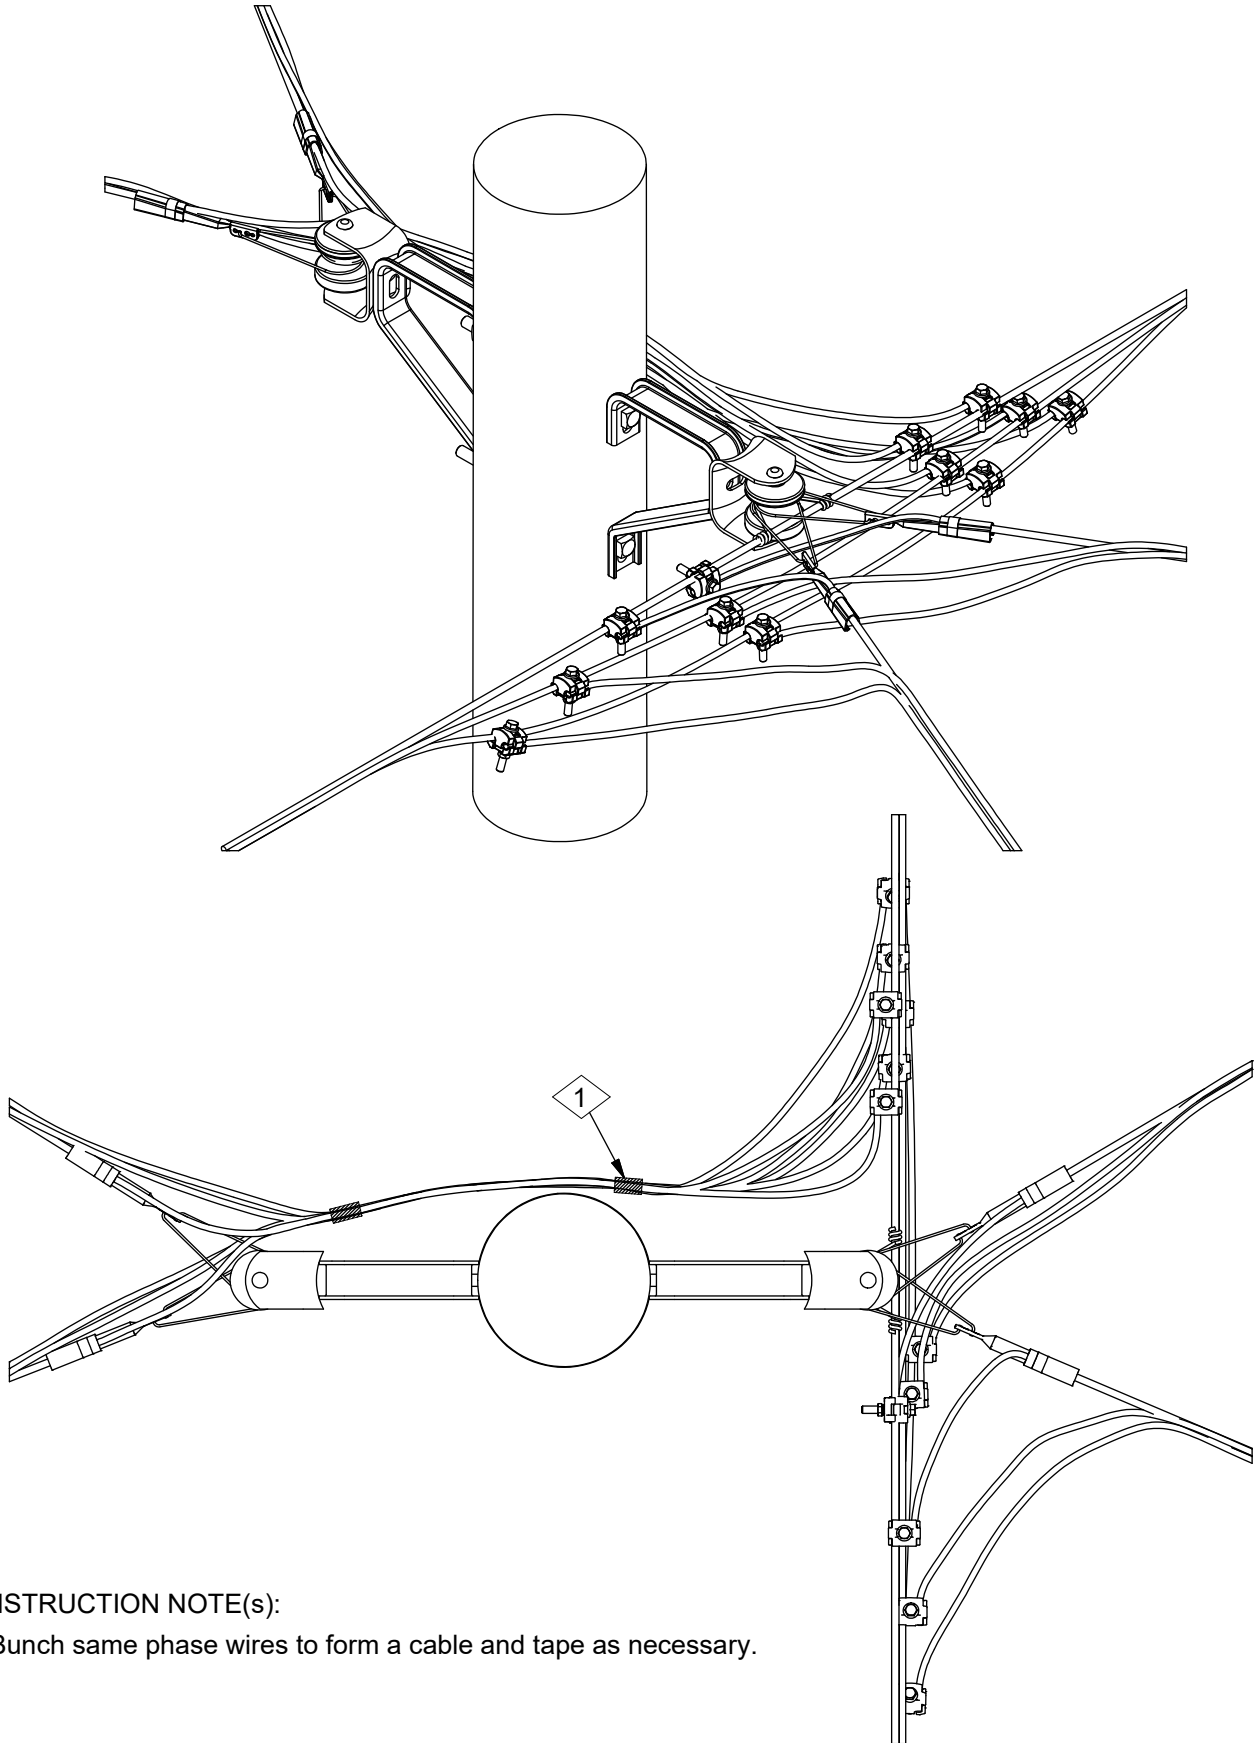

CONSTRUCTION NOTE(s):

- 1. Bunch same phase wires to form a cable and tape as necessary.


REV	DATE	ENG	DESCRIPTION
2	01/01/21	WYW	Converted to new format
1	09/18/06	JMW	

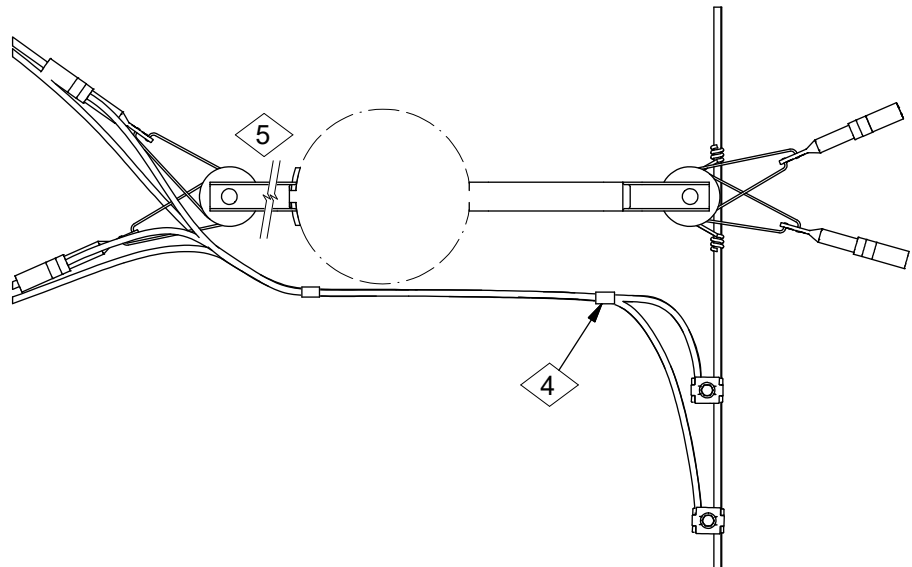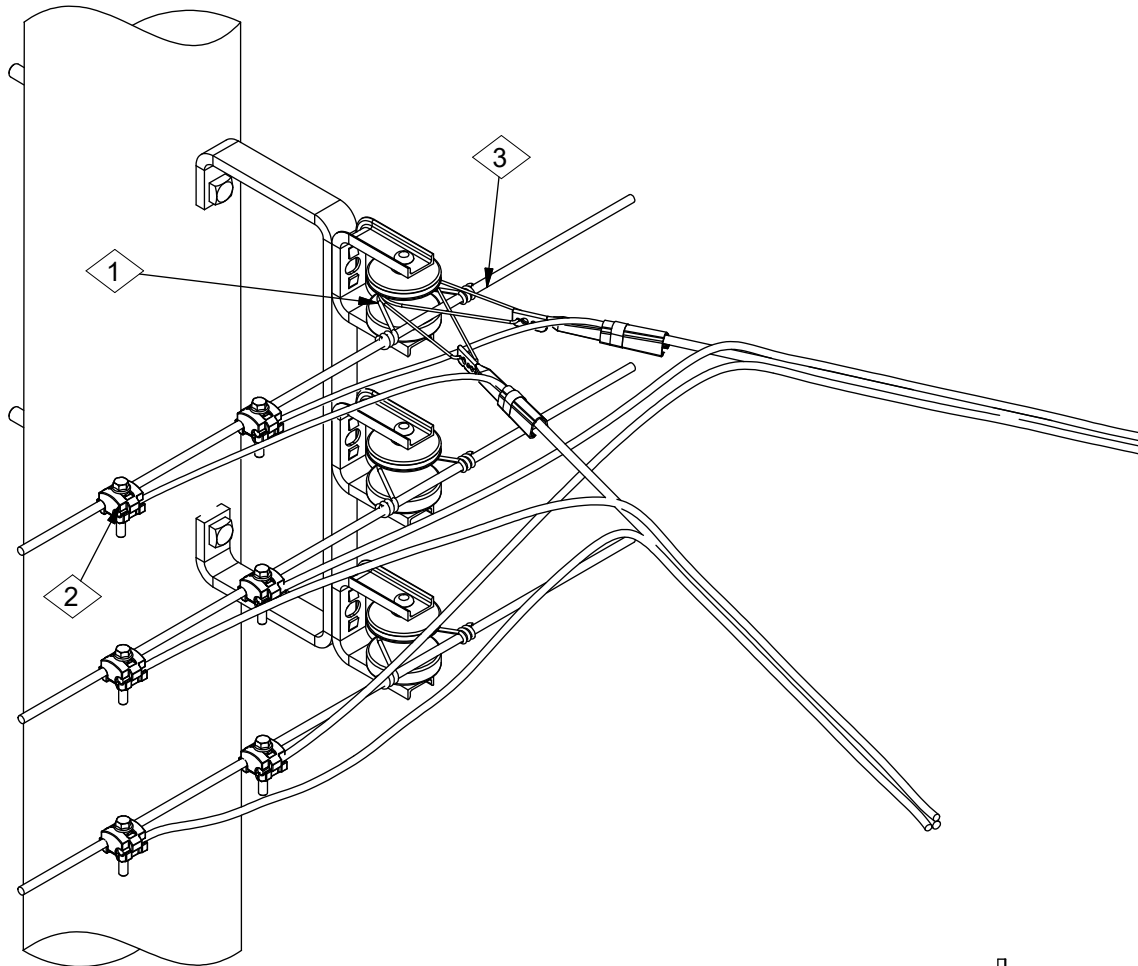


CONSTRUCTION NOTE(S):

- ① Attach wedge clamp to neutral conductor insulator.
- ② To prevent corrosion, apply lubricant before and after installing clamp, on voltage below 5kV tape connector.
- ③ Secondary conductor may be tied to either inside or outside of clevis.
- ④ Bunch same phase wires to forma cable and tape as necessary.
- ⑤ When required, use extension bracket on both sides, DCS **06 01 03 ****.

REV	DATE	ENG	DESCRIPTION
4	01/01/21	WYW	Converted to new format
3	09/18/06	JMW	

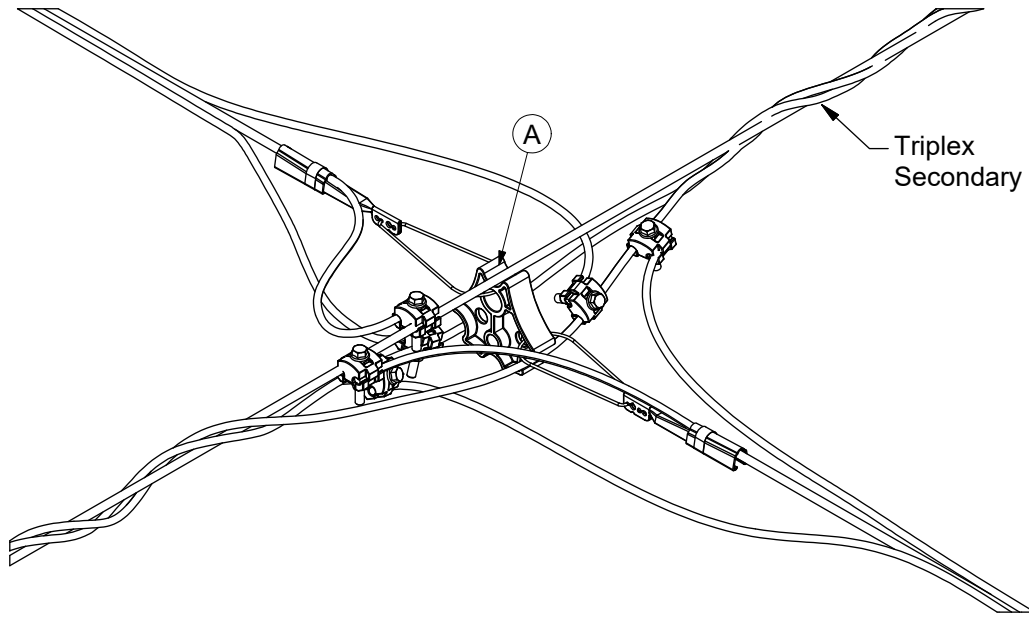

Unbalanced Secondary

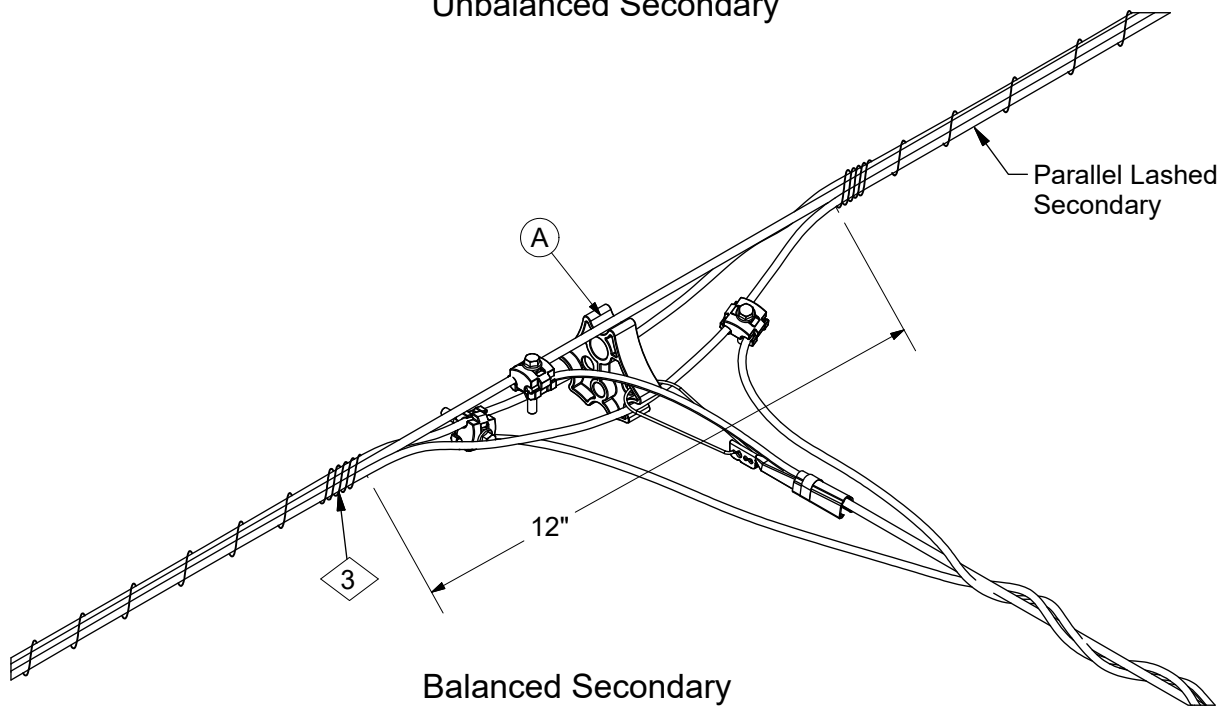


Balanced Secondary

CONSTRUCTION NOTE(S):

1. Pole separations in excess of 125 feet may require the installation of pole to pole or pole to anchor guying. For this condition or with 1/0 or larger services, use DCS **09 01 38 ****.
2. See DCS **09 01 10 **** for installation of service.
3. Terminate lashing ribbon with 5 close turns around entire cable and end on messenger with 2 turns and a half hitch. Train neatly and eliminate excess slack.

ITEM	STK / DCS #	DESCRIPTION	09 01 34 **	00
A	23 17 227	Spacer, Electrical Cable, 600v		1

REV	DATE	ENG	DESCRIPTION
2	01/01/21	WYW	Converted to new format
1	12/21/11	DCG	

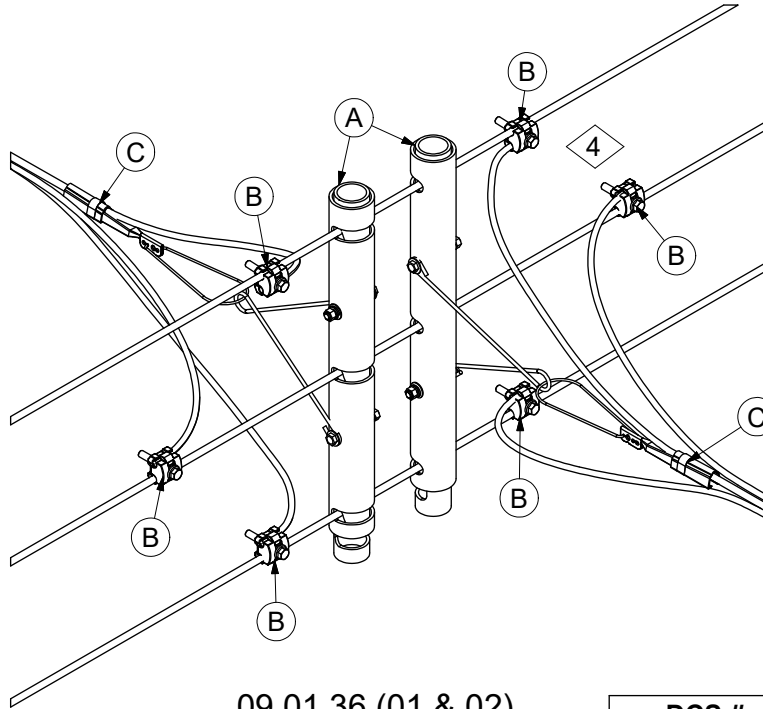

09 01 36 (01 & 02)


DCS #	DESCRIPTION
09 01 36 01	Balanced
09 01 36 02	Unbalanced

CONSTRUCTION NOTES:


1. This type of flying service is preferred for open wire secondary. See DCS **09 01 38 02** for alternate method.
2. Installation of unbalanced flying services in spaces where the construction is light and pole separation is in excess of 125 feet may require the installation of pole to pole or pole to anchor guying. Refer to DCS **09 01 38 02**.
3. See DCS **09 01 10 **** for termination of cable at house.
4. To prevent corrosion, apply lubricant (Stock #31 59 058) before and after installing clamp. On voltages below 5 kV, tape connector.
5. #2 triplex can be used for spans up to 140 feet, providing clearances required between low point of triplex service cable and finished ground grade is maintained. Refer to DCS **09 00 03 01**.
6. This type of flying service shall not be used for 1/0 or larger triplex. Use alternate construction, DCS **09 01 38 02**.
7. Secondary spreader includes telescoping tubes and one bridle to be used for unbalanced services. If a spare or salvaged bridle is available this can be added for balanced services (back-to-back). Otherwise, install a second unbalanced spreader facing the opposite direction.
8. Aluminum duplex cable, Stock #18 05 048, used for multiple street lighting circuits, may be attached to secondary as shown above. Use Stock #17 51 123 for wedge clamp.

ITEM	STK / DCS #	DESCRIPTION	09 01 36 **	01	02
A	23 17 219	Spreader Sec. 2 Cu & 4/0 AA		2	1
B	17 51 032	Clamp, Parallel Groove		6	3
C	17 51 123	Clamp, DE, #2 Triplex		2	1

REV	DATE	ENG	DESCRIPTION
4	01/01/21	WYW	Converted to new format
3	12/12/11	DCG	

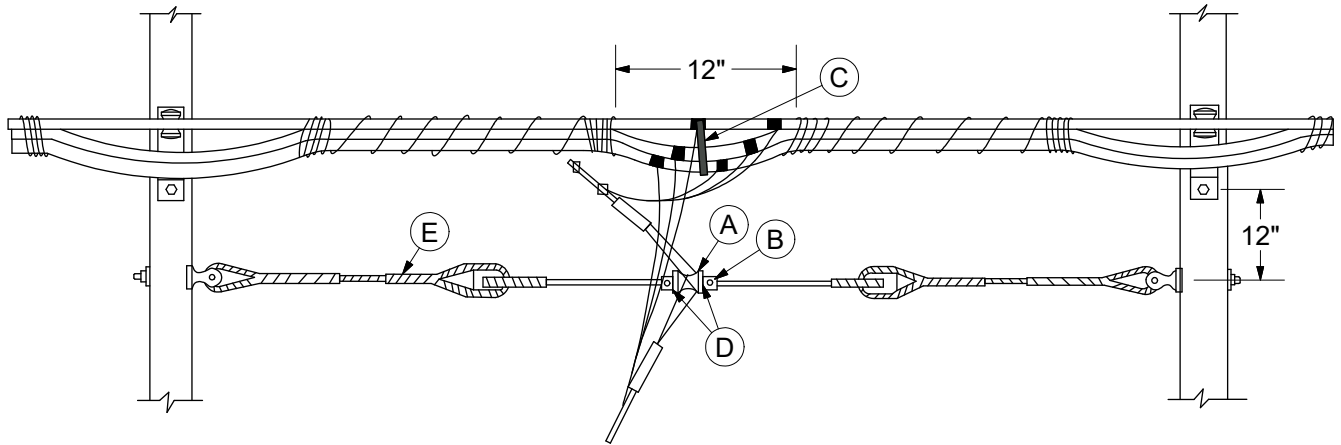

09 01 38 01
Parallel Lashed or Triplex Secondary

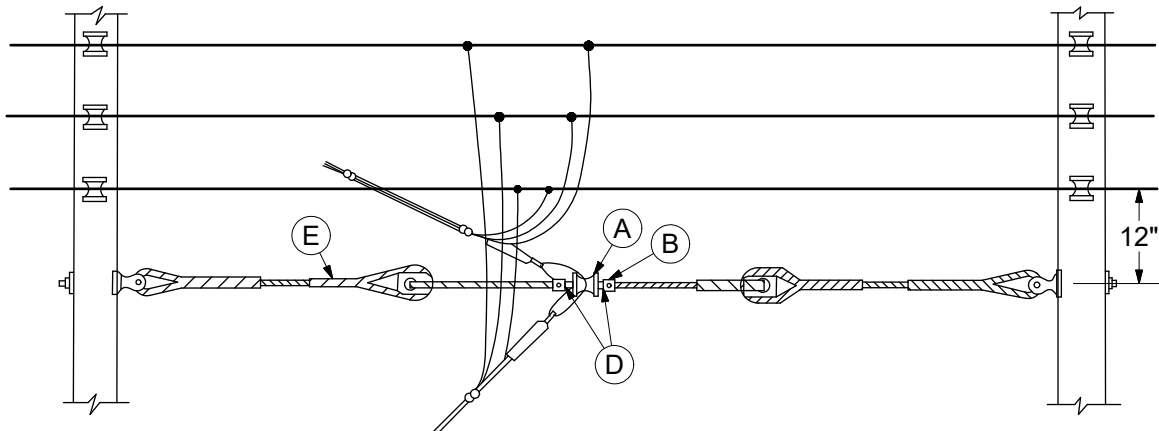



09 01 38 02
Open Wire Secondary

CONSTRUCTION NOTE(s):

- Installation of unbalanced flying services in spaces where the construction is light and pole separation is in excess of 125 feet may require the use of these standards.

	ITEM	STK / DCS #	DESCRIPTION	09 01 38 **	01	02
@	A	25 59 044	Insulator, Spool		1	1
	B	17 51 032	Clamp, Parallel Groove		2	2
	C	23 17 227	Spacer, Electrical Cable, 600v		1	-
	D	23 66 017	Washer - Round 1/2"		2	2
	E	11 00 46 03	Insulated, Guy Unit		1	1



REV	DATE	ENG	DESCRIPTION
4	01/01/21	WYW	Converted to new format
3	11/12/15	DCG	

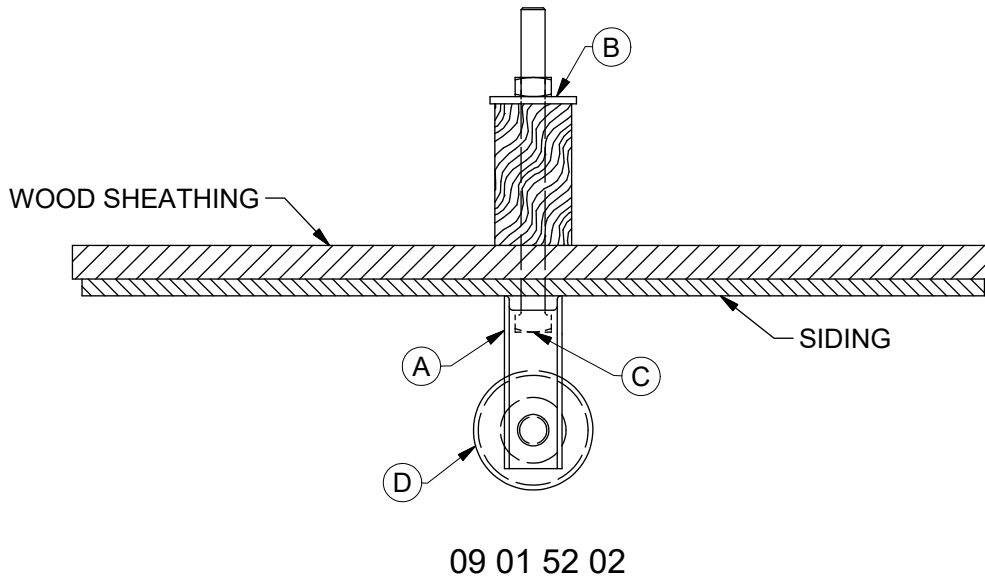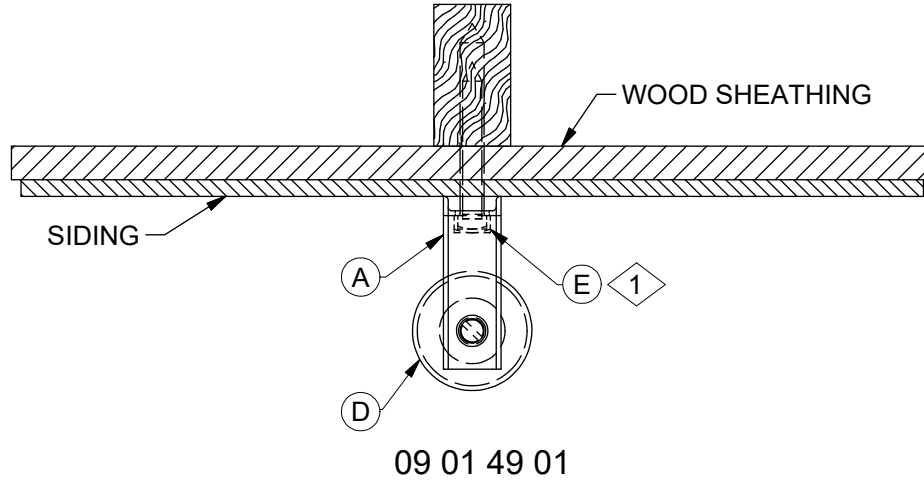

CONSTRUCTION NOTE(s):


1. Item E depends on thickness of sheathing:
 - a) Drill 3/8" lead hole for 1/2" x 4" lag screw
 - b) Drill 1/2" lead hole for 5/8" x 5" lag screw
2. Normally used where stud is accessible from the inside.

	ITEM	STOCK #	DESCRIPTION	09 01 49 **	01	02
1,@	A	23 06 040	Clevis - Secondary		1	1
	B	23 66 027	Washer - Square 5/8"		-	1
	C	23 52 061	Bolt, Mach., 5/8" x 8" w/ square nut		-	1
	D	25 59 044	Insulator, Spool		1	1
	E	23 60 011	Lag Screw - 5/8" x 5"		1	-
		23 60 007	Lag Screw - 1/2" x 4"		1	-

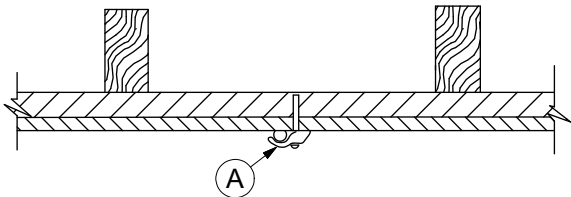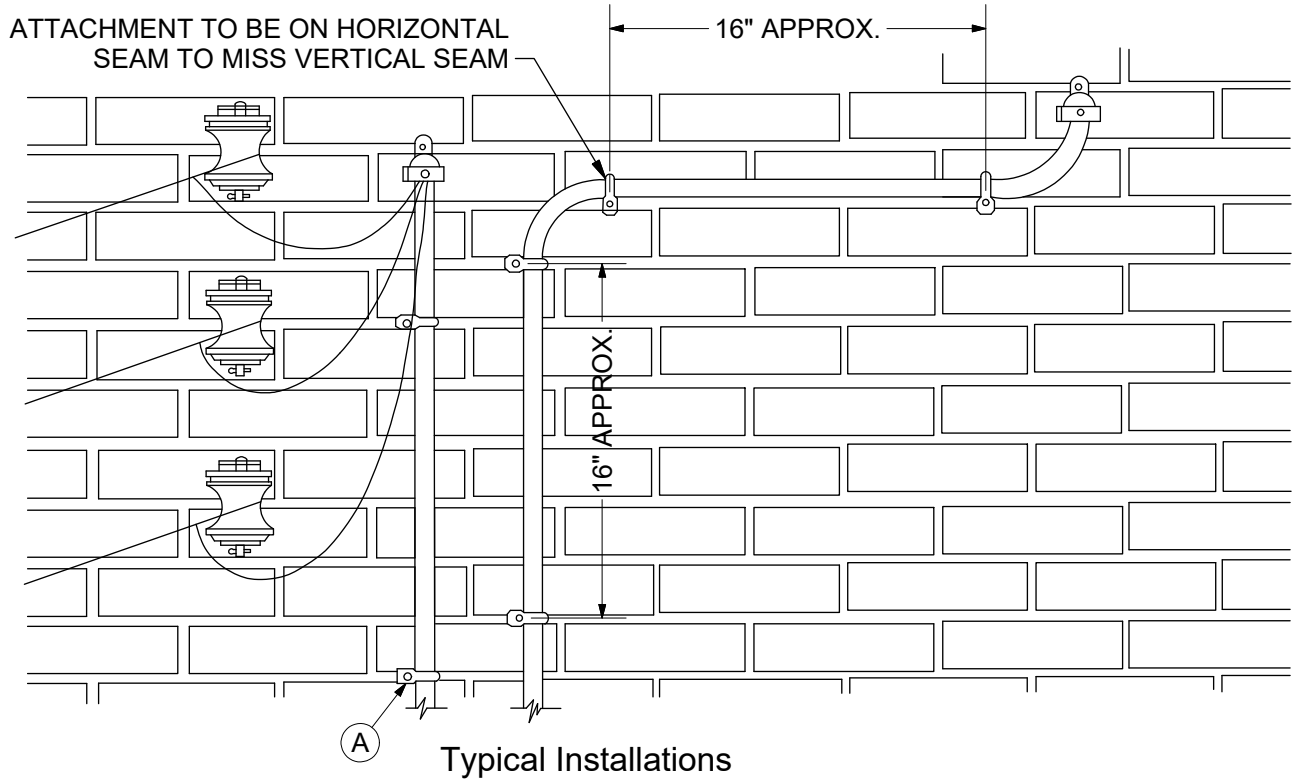

09 01 50 01

Wood Siding Composition Shingles

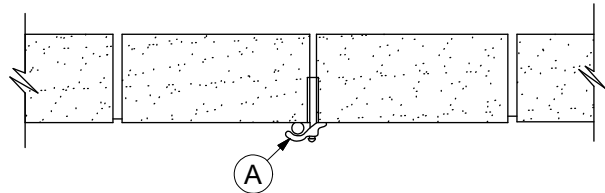

09 01 50 02


Solid Masonry Brick - Brick Veneer or Cement

CONSTRUCTION NOTE(S):


1. Cable straps shall be installed in horizontal seams within 2 ft. of corner of building or side of window and shall be installed in vertical seams within 1 ft. of top of wall or upper or lower edge of window.

ITEM	STK / DCS #	DESCRIPTION	09 01 50 **	01 or 02
A	21 71 022	Screw		As REQ'D
	40 59 107	Cable Strap for #8-2		
	40 59 014	Cable Strap for #4 - 3 & #2-3		
	21 51 009	Shield Expansion		

REV	DATE	ENG	DESCRIPTION
3	01/01/21	WYW	Converted to new format
2	12/12/11	DCG	

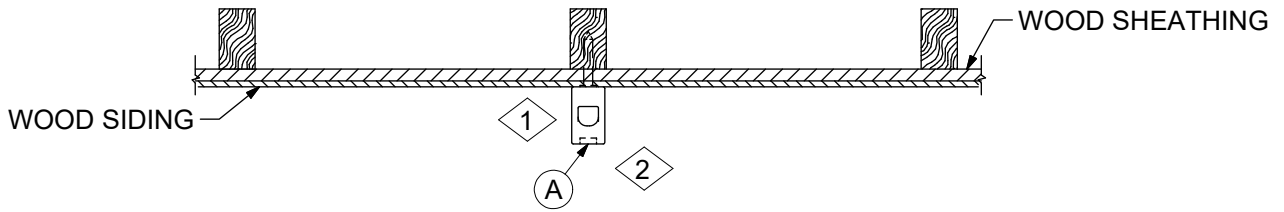

09 01 51 01
Wood Siding

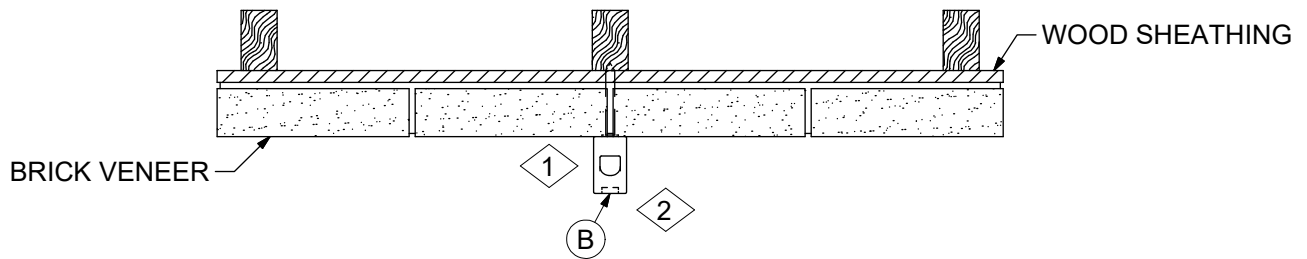


09 01 51 02
Brick Veneer or Composition Shingles



CONSTRUCTION NOTE(s):

- 1. Drill a lead hole 1/4" in diameter into stud or plate.
- 2. Knob may be installed between studs where wall materials are sound.

ITEM	STK / DCS #	DESCRIPTION	09 01 51 **	01	02
A	23 06 077	Insulator Wire Holder - 2-1/4"		1	-
B	23 17 241	Insulator Wire Holder - 3-1/2"		-	1

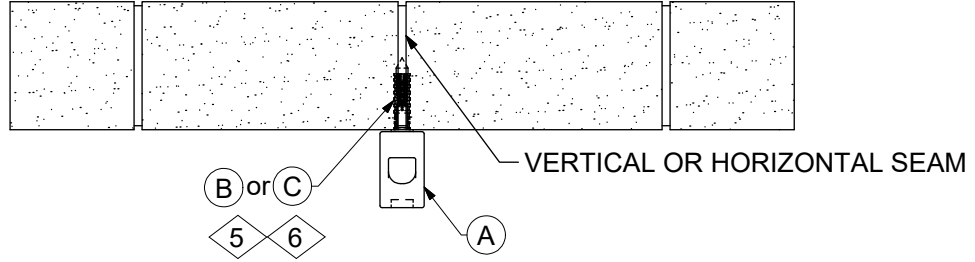

09 01 51 (03 & 04)

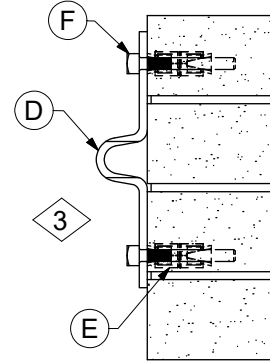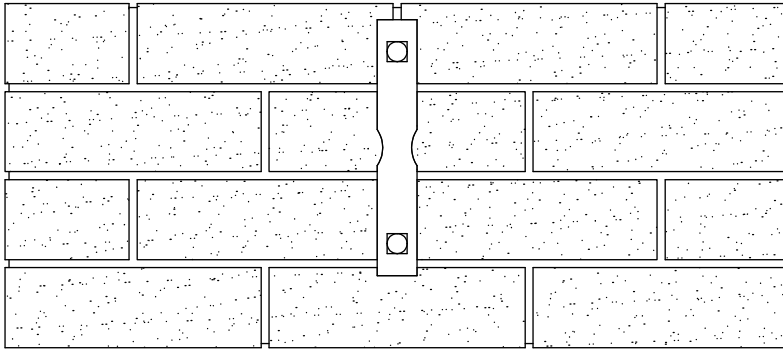

09 01 51 (05 & 06) 4

DCS #	DESCRIPTION
09 01 51 03	#4 to #2 Triplex or Open Wire
09 01 51 04	
09 01 51 05	1/0 Al Messenger
09 01 51 06	4/0 Al Messenger


CONSTRUCTION NOTE(s):

- 3 Mount bracket vertically on seams so that it spans one brick.
- 4 Also use for smaller services where due to nature of masonry porcelain knobs are unsatisfactory.
- 5 To be used with porcelain body wire holder item A.
- 6 To be used with nylon wire holder item A.

	ITEM	STK / DCS #	DESCRIPTION	09 01 51 **	03	04	05	06
5	A	23 06 077	Insulator Wire Holder - 2-1/4"		1	1	-	-
	B	21 51 055	Shield, Exp., #22 Screw		-	1	-	-
6	C	21 51 181	5/16" EXPANSION SHIELD		1	-	-	-
3	D	23 06 057	Bracket, Wall Triplex		-	-	1	1
	E	21 51 018	Shield, Exp., 1/2"		-	-	-	2
		21 51 016	Shield, Exp., 3/8"		-	-	2	-
	F	23 52 034	Bolt, Mach., 1/2" x 4" w/ square nut		-	-	-	2
		23 52 194	Bolt, Mach., 3/8" x 3" w/ square nut		-	-	2	-

**DISTRIBUTION
CONSTRUCTION STANDARDS**



REV	DATE	ENG	DESCRIPTION
1	01/01/21	WYW	Moved from DCS 06 01 50 **

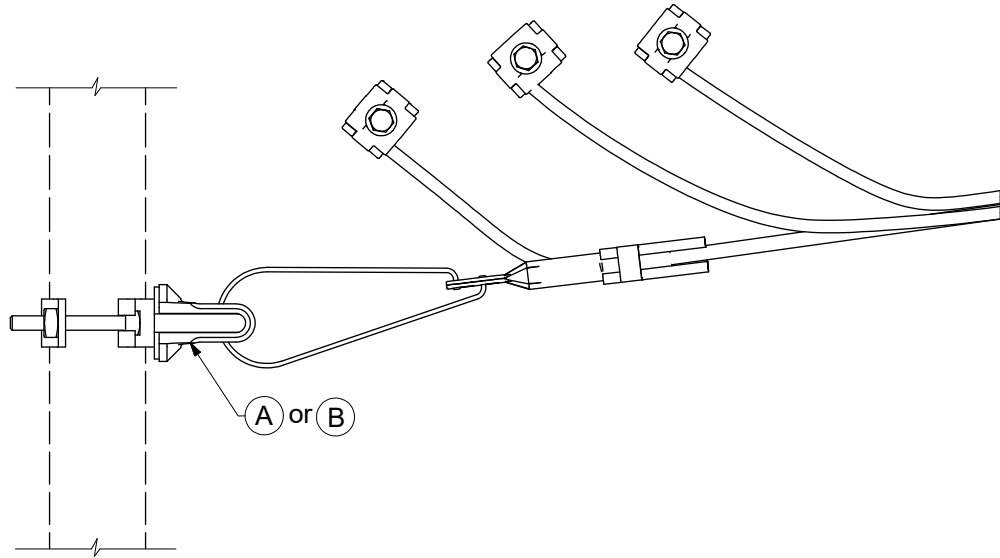

09 01 51 (07 & 08)

ITEM	STK / DCS #	DESCRIPTION	09 01 51 **	07	08
A	23 06 075	Insulator, Wire Holder, 1-1/4" to 2-1/2" Mast		1	-
B	23 06 082	Insulator, Wire Holder, 3" to 4" Mast		-	1

REV	DATE	ENG	DESCRIPTION
1	01/01/21	WYW	Moved from DCS 06 01 50 **

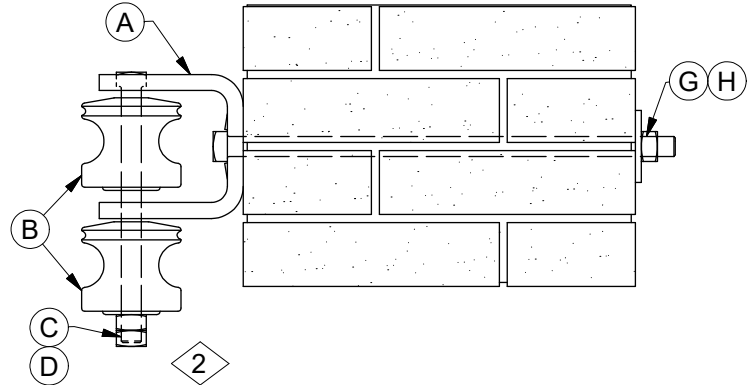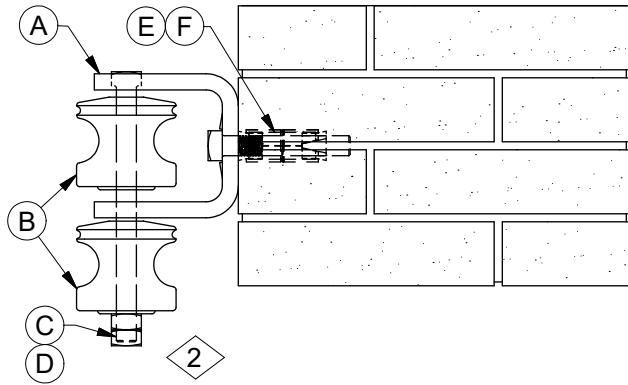

Solid Masonry - Brick Or Cement		
DCS #	Description	Conductor Range
09 01 53 01	1 Spool	Up to #4
09 01 53 02	1 Spool	#2 to #4/0
09 01 53 03	1 Spool	500 to 750 MCM
09 01 53 04	2 Spools 1	Up to #4
09 01 53 05	2 Spools 1	#2 to #4/0
09 01 53 06	2 Spools 1	500 to 750 MCM


Solid Masonry - Brick Or Cement		
DCS #	Description	Application
09 01 53 07	1 Spool	To be used when the stud is accessible from inside.
09 01 53 08	2 Spools 1	

CONSTRUCTION NOTE(s):

- 1. The double spool insulator is to be used only for attaching network cable to buildings excluding deadend constructions.
- 2. The 2 square nuts are jammed together.

ITEM	STOCK #	DESCRIPTION	09 01 53 **	01	02	03	04	05	06	07	08
A	23 06 040	Clevis - Secondary Insulator		1	1	1	1	1	1	1	1
B	25 59 044	Insulator, Spool		1	1	1	2	2	2	1	2
C	23 52 061	Bolt, Mach., 5/8" x 8" w/ square nut		-	-	-	1	1	1	-	1
D	23 65 011	Nut, Square, 5/8"		-	-	-	1	1	1	-	1
E	21 51 016	Shield, Exp., 3/8"		1	-	-	1	-	-	-	-
	21 51 018	Shield, Exp., 1/2"		-	1	-	-	1	-	-	-
	21 51 019	Shield, Exp., 5/8"		-	-	1	-	-	1	-	-
F	23 52 194	Bolt, Mach., 3/8" x 3" w/ square nut		1	-	-	1	-	-	-	-
	23 52 034	Bolt, Mach., 1/2" x 4" w/ square nut		-	1	-	-	1	-	-	-
	23 52 200	Bolt, Mach., 5/8" x 4" w/ square nut		-	-	1	-	-	1	-	-
G	23 52 066	Bolt, Mach., 5/8" x 14" w/ square nut		-	-	-	-	-	-	1	1
H	23 66 027	Washer - Square 5/8"		-	-	-	-	-	-	1	1

REV	DATE	ENG	DESCRIPTION
1	01/01/21	WYW	Moved from DCS 06 01 58 ** & created table for clarification

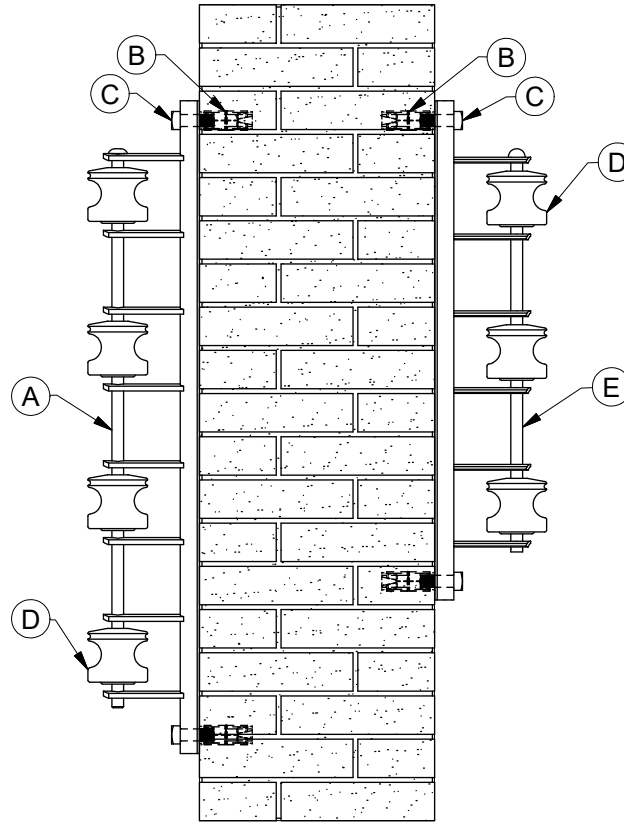


DCS #	DESCRIPTION
09 01 54 01	4-Wire
09 01 54 02	3-Wire

CONSTRUCTION NOTE(s):


1. The square nut provided with machine bolt, is not used for this application.

	ITEM	STOCK #	DESCRIPTION	09 01 54 **	01	02
1	A	23 11 004	Rack, Secondary, 4-Wire		1	-
	B	21 51 019	Shield, Exp., 5/8"		2	2
	C	23 52 438	Bolt, Mach., 5/8" x 3" w/ square nut		2	2
	D	25 59 044	Insulator, Spool		4	3
	E	23 11 001	Rack, Secondary, 3-Wire		-	1

Method 1

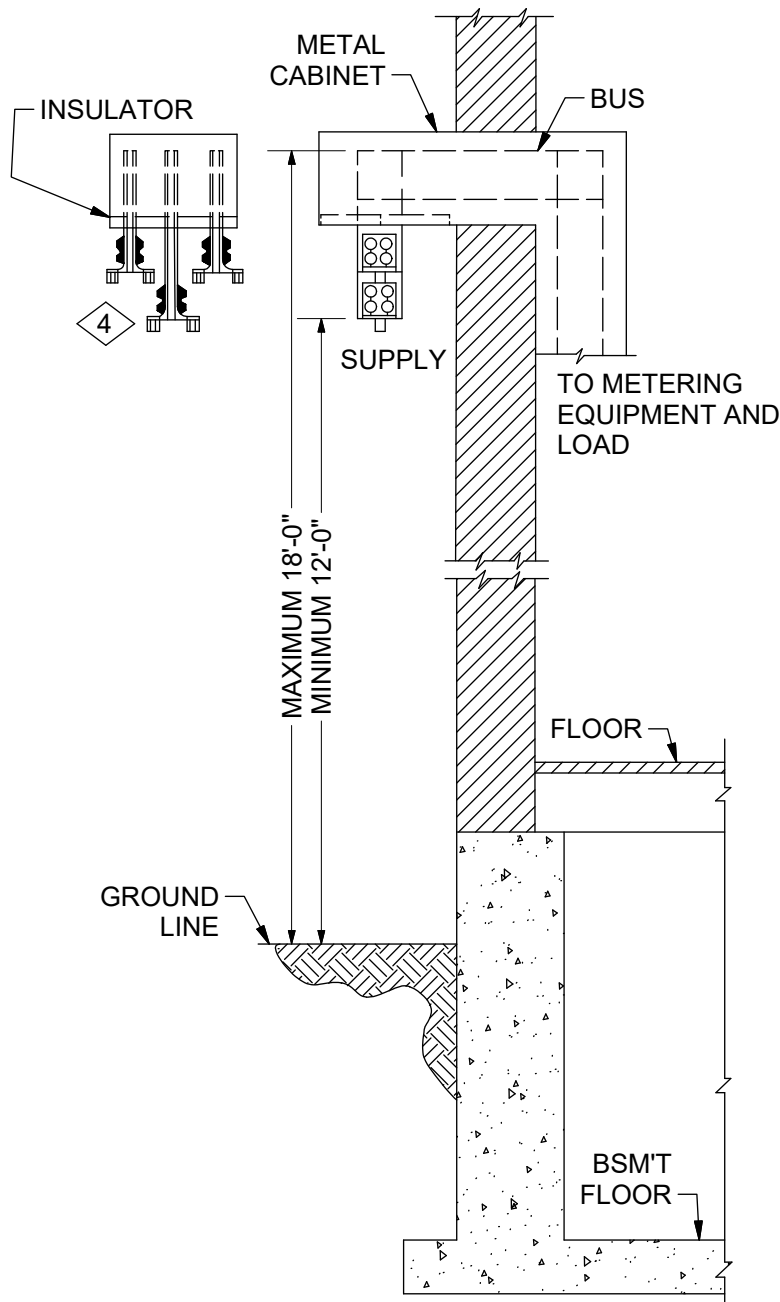

Method 2 (Drawing shall be submitted for approval)

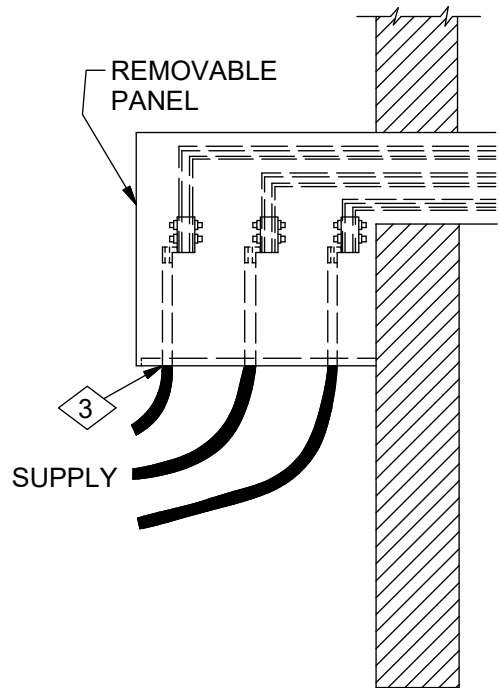

Metal Cabinet - Bolts & Lugs		
Service Size - Amps	NO.	Lug Size
0 - 1000	1	500 / 750
1001 - 2000	2	500 / 750
2001 - 3000	3	500 / 750
3001 - 4000	4	500 / 750

Equipment to be Furnished by Customer



CONSTRUCTION NOTE(S):

1. All equipment, including connector lugs and everdur bolts, shall be furnished and installed by customer. Ameren to make connection to service wires.
2. Any deviation from this standard shall be approved by Ameren Engineer prior to installation.

③ Insulator board to be drilled for conductors. Size to be determined by Ameren.

④ 3-Wire shown. For 4-Wire add 4th Bus.

REV	DATE	ENG	DESCRIPTION
2	01/01/21	WYW	Converted to new format
1	10/27/11	DCG	

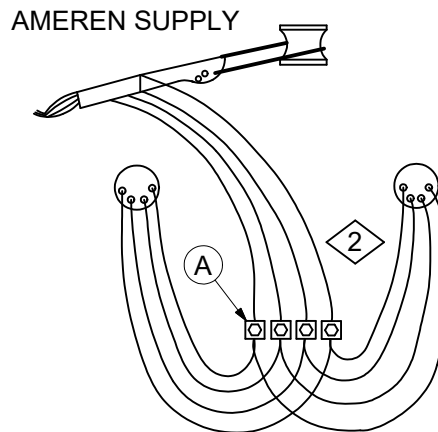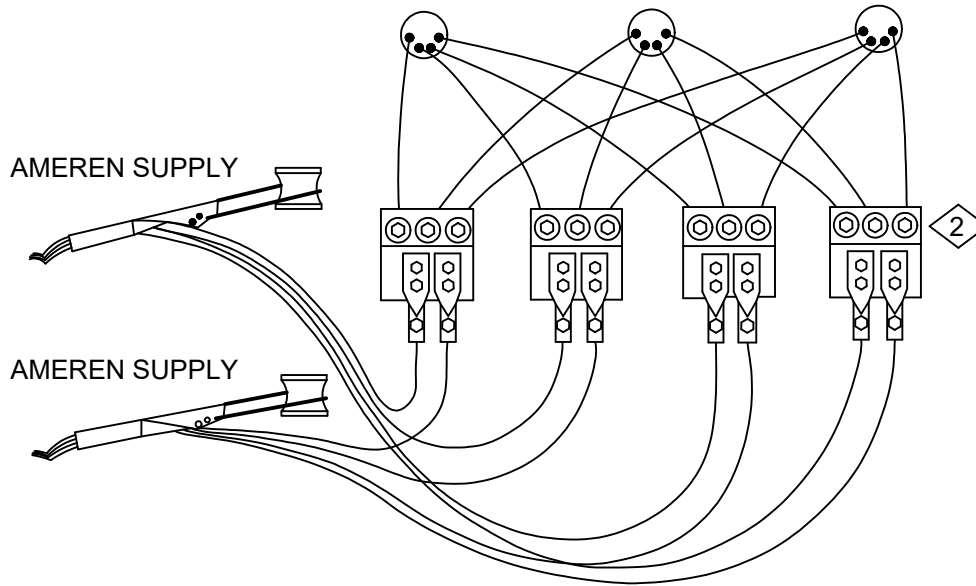


CONSTRUCTION NOTE(s):

- This type of connection is undesirable and to be used only when a bus-bar outlet cannot be used. Each job shall be specifically approved and configuration agreed upon by Ameren Engineer prior to construction.

- ② Customer:
- Gather service entrance conductors
 - Provide 2 and 3 barrel NEMA 4-hole lugs and bolt together
- Company:
- Make final connection and tape
 - Tape conductors together for mechanical support

	ITEM	STK / DCS #	DESCRIPTION	09 01 58 **	00
@	A	17 64 244	Connector Insulated Set Screw, 6 Holes, #4 AWG to 600kcmil, Al or Cu		#
		17 64 245	Connector Insulated Set Screw, 6 Holes, 250kcmil to 750kcmil, Al or Cu		#

REV	DATE	ENG	DESCRIPTION
3	01/01/21	WYW	Converted to new format & added BOM
2	08/25/11	DCG	

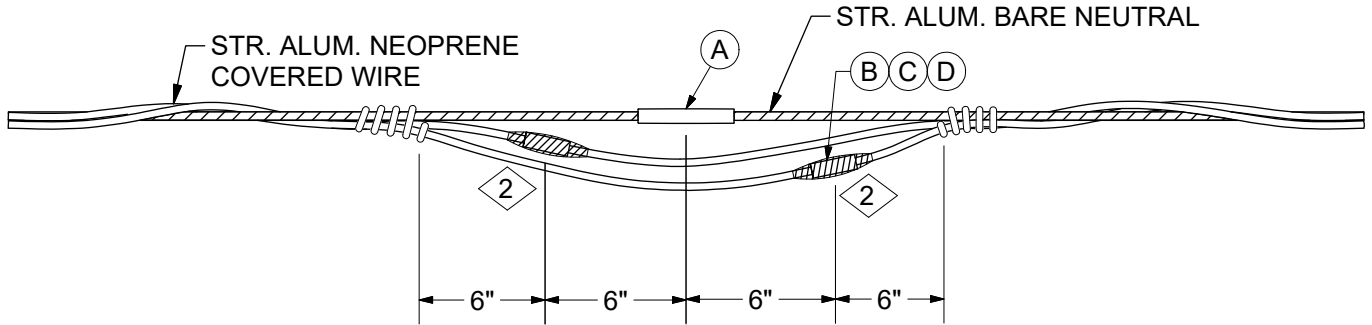

CONSTRUCTION NOTE(s):

- Triplex splicing sleeve shall be used to make full tension splices in triplex cables. The available sleeves are shown as follows:

Stock #	Size
17 60 160	1/0 Al
17 60 187	#2 Al
17 60 188	#4 Al
17 60 625	#2 - #4 Al

- Tape with two layers half lapped rubber based tape (Stock #25 53 080) and cover with same amount DF Friction tape (Stock #25 53 003).

ITEM	STK / DCS #	DESCRIPTION	09 01 60 **	01	02	03
A	17 60 188	Sleeve, Splicing, 4 Al.	1	-	-	-
	17 60 187	Sleeve - Compression Cu 1/0 to #2	-	1	-	-
	17 60 160	Sleeve, Full Tension, 1/0 Al.	-	-	-	1
B	17 60 180	Sleeve - Compression, Non Tension 5/8" O.D. #3 or #4	2	-	-	-
	17 60 182	Sleeve - #2 Al	-	2	-	-
	17 60 319	Sleeve - Compression 1/0 Str. to 1/0	-	-	-	2
C	25 53 080	Tape, Rubber, Insl.	1	1	1	1
D	25 53 003	Tape, Friction	1	1	1	1
E	23 68 313	Tie, Cable, Tplx., Poly.	2	2	2	2

REV	DATE	ENG	DESCRIPTION
3	01/01/21	WYW	Converted to new format
2	12/08/09	EJB	